

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances

See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances


Design No. **V493**

August 4, 2023


Nonbearing Wall Rating — 1 and 2 Hr

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**


System A - 1 Hr.

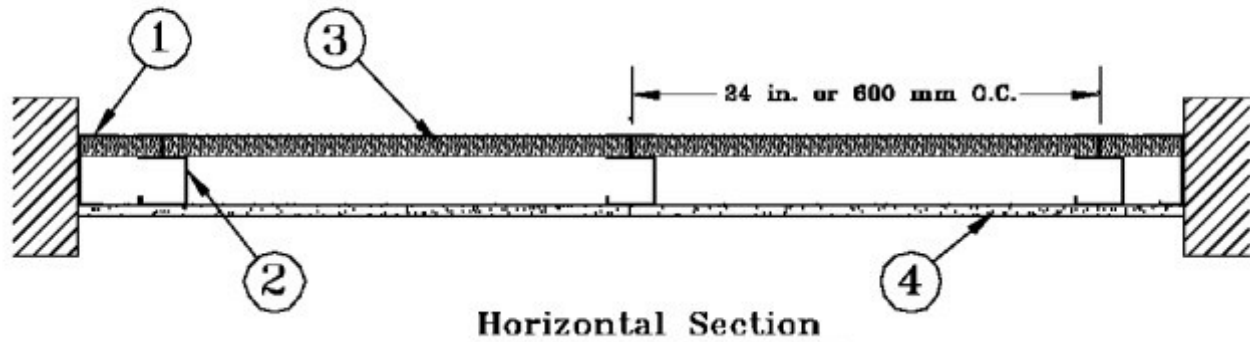


System A - 1 Hr.

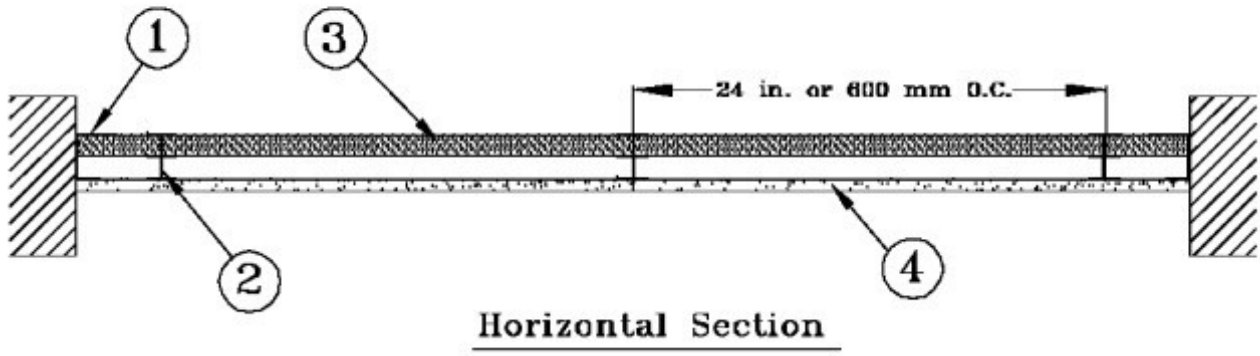


System B - 2 Hr.

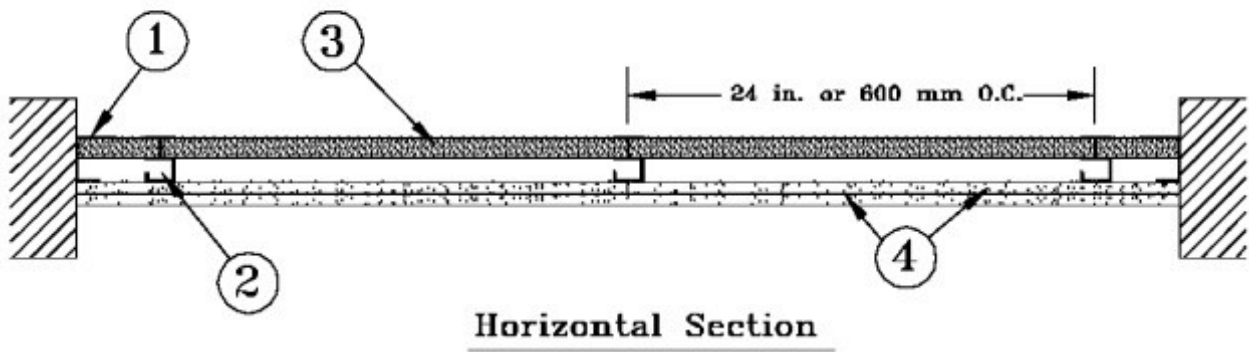


System B - 2 Hr.

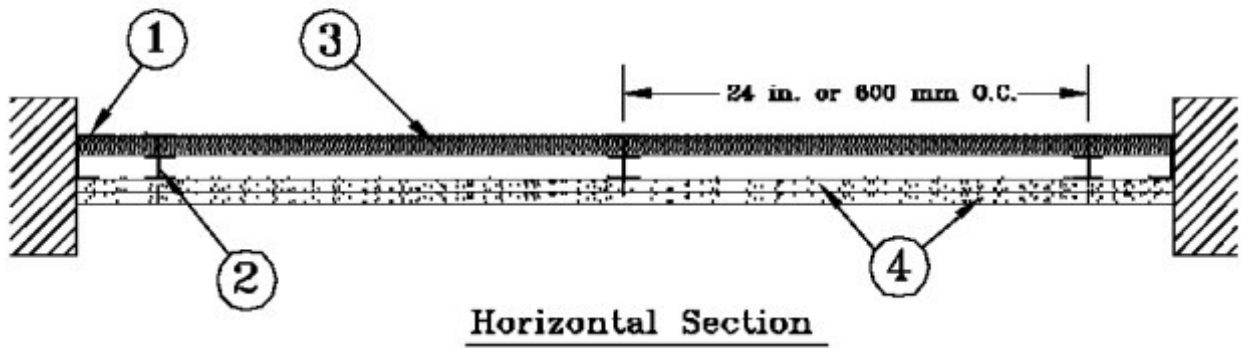

System C - 2 Hr.

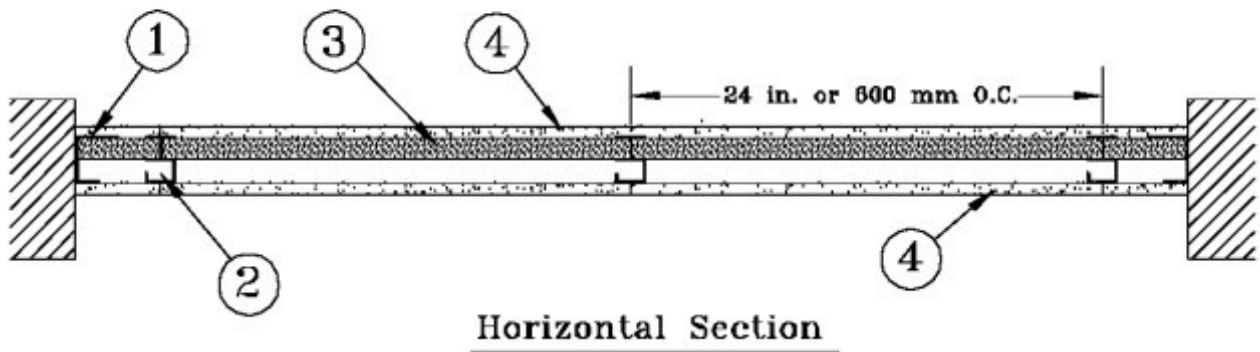

System C - 2 Hr.

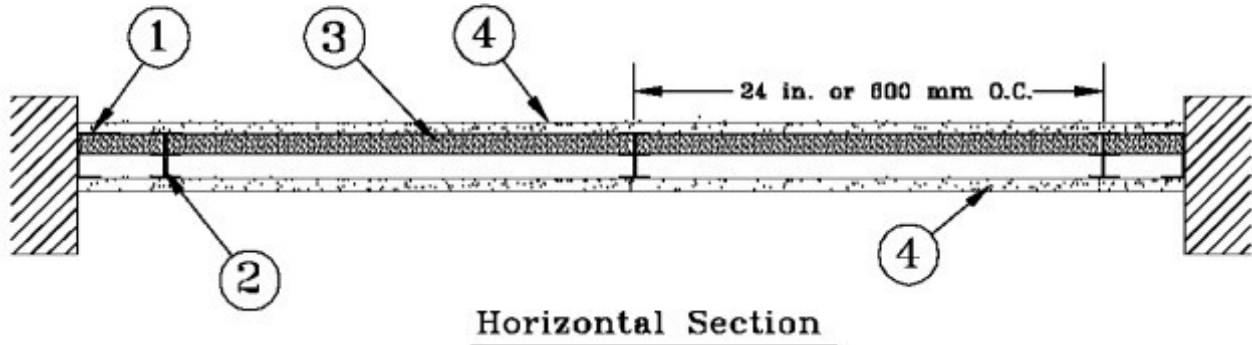

1. **Floor, Side and Ceiling Runners** — "J" -shaped runner, min 2-1/2 in. deep, with unequal legs of 1-1/8 in. and 2-1/8 in., fabricated from min 25 MSG galv steel. Runners positioned with short leg toward finished side of wall. Runners attached to structural supports with steel fasteners located not greater than 2 in. from ends and not greater than 24 in. OC.

2. **Steel Studs** — "I", "C-H, or "C-T" shaftwall studs. "C-T" or "C-H" -shaped studs, min 2-1/2 in. deep, 1-5/8 in. wide, fabricated from min 25 MSG galv steel. Cut to lengths 5/8 in. less than floor-to-ceiling height and spaced 24 in. Or, "I" -shaped studs fabricated from min 25 MSG galv steel, min 2-1/2 in. deep, 1-1/2 in. wide. Studs contain 3/4 in. wide by 2-1/4 in. high holding tabs spaced 2-3/4 in. OC on opposite sides of the stud and 12 in. vertically. Cut to lengths 5/8 in. less than floor-to-ceiling height and spaced 24 in.

2A. **Furring Channels** — (Optional, not shown) — Resilient furring channels fabricated from min 25MSG corrosion protected steel, installed horizontally, and spaced vertically a max 24 in. OC. Flange portion of channel attached to each intersecting "C-H", "C-T" or "I" stud on side of stud opposite the 1 in. liner panels with 1/2 in. long Type S or S-12 pan-head steel screws.

3. **Gypsum Board*** — Gypsum liner panels, nom 1 in. thick, 24 in. wide. Panels cut max 1/4 in. less in length than floor to ceiling height. Vertical edges inserted in "T" -shaped section of "C-T" studs, Vertical edges inserted in "H" -shaped section of "C-H" studs, or holding tabs of "I" studs. Free edge of end panels attached to long leg of "J" -runners with 1-5/8 in. long Type S bugle head steel screws spaced not greater than 12 in. OC.

GEORGIA-PACIFIC GYPSUM L L C — Types TP-6, DGUSL, and TRSL

System A

4. **Gypsum Board*** — Gypsum panels, nom 5/8 in. thick, 48 in. wide, applied vertically or horizontally with edges centered over studs, with 1 in. long Type S bugle head steel screws spaced 12 in. OC when applied vertically, or 8 in. OC when applied horizontally. Type X ComfortGuard Sound Deadening Gypsum Board to be installed vertically only.

GEORGIA-PACIFIC GYPSUM L L C — Type X, Veneer Plaster Base-Type X, Water Rated-Type X, Sheathing Type-X, Soffit-Type X, Greenglass Type X, TG-C, Type X ComfortGuard Sound Deadening Gypsum Board, Type LWX, Veneer Plaster Base-Type LWX, Water Rated-Type LWX, Sheathing Type-LWX, Soffit-Type LWX, Type DGLW, Water Rated-Type DGLW, Sheathing Type- DGLW, Soffit-Type DGLW, Type LW2X, Veneer Plaster Base - Type LW2X, Water Rated - Type LW2X, Sheathing - Type LW2X, Soffit - Type LW2X, Type DGL2W, Water Rated - Type DGL2W, Sheathing - Type DGL2W.

System B

1/2 or 5/8 in. thick, 4 ft wide, applied in two layers. Base layer attached horizontally to studs and side "J" runners with 1 in. long Type S self-tapping steel screws starting at 2 in. from the floor and ceiling runners and spaced a maximum 24 in. OC along the vertical edges and in the field of the boards. Type X ComfortGuard Sound Deadening Gypsum Board to be installed vertically only as described above with screws spaced a maximum 12 in. OC.

Face layer applied vertically to studs and side "J" runners and attached with 1-5/8 in. long Type S self-tapping steel screws, starting at 3 in. from the floor and ceiling runners and spaced a maximum 12 in. OC along the vertical edges and in the field of the boards. Face layer joints covered with paper tape and two coats of joint compound. Exposed screw heads covered with two coats of joint compound.

GEORGIA-PACIFIC GYPSUM L L C — 1/2 or 5/8 in. Type TG-C, 5/8 in. Type X, Veneer Plaster Base-Type X, Water Rated-Type X, Sheathing Type-X, Soffit-Type X, Greenglass Type X, Type X ComfortGuard Sound Deadening Gypsum Board, Type LWX, Veneer Plaster Base-Type LWX, Water Rated-Type LWX, Sheathing Type-LWX, Soffit-Type LWX, Type DGLW, Water Rated-Type DGLW, Sheathing Type- DGLW, Soffit-Type DGLW, Type LW2X, Veneer Plaster Base - Type LW2X, Water Rated - Type LW2X, Sheathing - Type LW2X, Soffit - Type LW2X, Type DGL2W, Water Rated - Type DGL2W, Sheathing - Type DGL2W.

System C

1/2 or 5/8 in. thick, 4 ft wide, applied vertically and attached to studs and runners with 1 in. long Type S steel screws starting at 2 in. from the top and the bottom, and spaced at 12 in. OC. Vertical joints are offset one stud space each side. Outer layer joints covered with paper tape and two coats of joint compound. Exposed screw heads covered with two coats of joint compound.

GEORGIA-PACIFIC GYPSUM L L C — 1/2 or 5/8 in. Type TG-C, 5/8 in. Type X, Veneer Plaster Base-Type X, Water Rated-Type X, Sheathing Type-X, Soffit-Type X, Greenglass Type X, Type X ComfortGuard Sound Deadening Gypsum Board, Type LWX, Veneer Plaster Base-Type LWX, Water Rated-Type LWX, Sheathing Type-LWX, Soffit-Type LWX, Type DGLW, Water Rated-Type DGLW, Sheathing Type- DGLW, Soffit-Type DGLW, Type LW2X, Veneer Plaster Base - Type LW2X, Water Rated - Type LW2X, Sheathing - Type LW2X, Soffit - Type LW2X, Type DGL2W, Water Rated - Type DGL2W, Sheathing - Type DGL2W.

5. Joint Tape and Compound — (Not shown) — Joints covered with joint compound and paper or mesh tape. Screw heads covered with joint compound.

6. Batts and Blankets* — (Optional- Not Shown) — Mineral wool or glass fiber batts partially or completely filling stud cavity. Any mineral wool or glass fiber batt mineral bearing the UL Classification Marking as to Fire Resistance. See Batt and Blankets (BZJZ) category for names of Classified Companies.

6A. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 6) — (100% Borate Formulation) — Spray applied cellulose material. The fiber is applied with water to completely fill the enclosed cavity in accordance with the application instructions supplied with the product with a nominal dry density of 2.7 lb/ft³. Alternate Application Method: The fiber is applied without water or adhesive at a nominal dry density of 3.5 lb/ft³, in accordance with the application instructions supplied with the product.

Applegate Greenfiber Acquisition LLC — Insulmax and SANCTUARY for use with wet or dry application.

6B. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 6) - Spray applied cellulose insulation material. The fiber is applied with water to interior surfaces in accordance with the application instructions supplied with the product. Applied to completely fill the enclosed cavity. Minimum dry density of 4.3 pounds per cubic ft.

NU-WOOL CO INC — Cellulose Insulation

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2023-08-04

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2024 UL LLC."