

# ICC-ES Evaluation Report

**ESR-2620**

Reissued July 2023

Revised November 2024


Subject to renewal July 2025

This report also contains:

- [City of NY Supplement](#)
- [CA Supplement w/ DSA and OSHPD](#)
- [FL Supplement w/ HVHZ](#)

ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.

Copyright © 2024 ICC Evaluation Service, LLC. All rights reserved.

<p><b>DIVISION: 05 00 00—METALS</b></p> <p><b>Section: 05 40 00—Cold-Formed Metal Framing</b></p> <p><b>DIVISION: 09 00 00—FINISHES</b></p> <p><b>Section: 09 22 16.13—Non-Structural Metal Stud Framing</b></p>	<p><b>REPORT HOLDER:</b></p> <p><b>WARE INDUSTRIES, INC. (DBA MarinoWARE)</b></p> <p><b>ADDITIONAL LISTEES:</b></p> <p><b>CEMCO, LLC</b></p> <p><b>IMPERIAL BUILDING PRODUCTS</b></p>	<p><b>EVALUATION SUBJECT:</b></p> <p><b>VIPERSTUD DRYWALL FRAMING SYSTEM (NON-STRUCTURAL):</b></p> <p><b>VIPER25, VIPER20, VIPER20D, VIPER 18MIL, VIPER 27MIL, VIPER 30MIL, AND VIPER 33MIL</b></p>	
--	---	---	---

## 1.0 EVALUATION SCOPE

**Compliance with the following codes:**

- 2024, 2021, 2018 and 2015 [International Building Code® \(IBC\)](#)
- 2024, 2021 and 2018 [International Residential Code® \(IRC\)](#)

**Property evaluated:**

Structural

## 2.0 USES

ViperStud studs and tracks are used for framing of interior nonload-bearing walls and ceiling framing.

## 3.0 DESCRIPTION

### 3.1 General:

Products recognized under this report are limited to the ViperStud studs and tracks noted in [Table 2](#). The studs are roll-formed in a “C” shape with a rib (ViperRib) in the flange, an offset (planking) in the web and knurling on the flanges. The tracks are channel-shaped and are available in two types: solid flanges and slotted flanges. Solid flange tracks have offsets (planking) in the web with flange widths of 1.25 inches (31.75 mm). Slotted flange tracks have a straight web with flange widths of 2.5-inch (63.5 mm) and are limited to top track applications in walls. The last two digits of the member’s ID in [Table 2](#) represent its minimum uncoated base-metal thickness in mils for studs and tracks. Minimum and design thicknesses are:

Mils	Minimum Base-Metal Thickness (inches)	Design Thickness (inches)
15	0.0147	0.0155
18*	0.0181	0.0190
20	0.0195	0.0205
21	0.0209	0.0220
27	0.0269	0.0283
30	0.0296	0.0312
33	0.0329	0.0346

For SI: 1 inch = 25.4 mm.

\*For Grade 33 studs and tracks the minimum uncoated base-metal thickness and design thickness are 0.0179 and 0.0188 inches, respectively.

The studs are manufactured with and without punch-outs. The overall dimensions for the punch-outs are:

MANUFACTURER	MEMBER DEPTH	
	1 <sup>5</sup> / <sub>8</sub> " & 2 <sup>1</sup> / <sub>2</sub> "	3 <sup>5</sup> / <sub>8</sub> ", 4" & 6"
MarinoWARE	0.75" x 1.75"	1.50" x 2.50"
CEMCO	0.75" x 2.00"	1.50" x 2.75"
Imperial Building Products	0.75"x3.53"	1.50"x4.22"

For SI: 1 inch = 25.4 mm.

Punch-outs are spaced 24 inches (610 mm) on center along the centerline of the member, with a minimum distance of 10 inches (254 mm) from the end of the member to the near edge of the punch-out, when provided. See [Figure 1](#) for stud and track configurations. See [Figure 2](#) for punch-out configurations. See [Table 1](#) for manufacturing locations.

### 3.2 Material:

#### 3.2.1 Steel:

The members, as noted in [Table 2](#), are formed from coils of steel complying with ASTM A1003; Nonstructural Grade 33 (NS33), Nonstructural Grade 50 (NS50), Nonstructural Grade 57 (NS57), and Nonstructural Grade 70 (NS70). The coating is per AISI S220-20, Section A4.1.1 (minimum G40 or equivalent).

**3.2.2 Gypsum Wallboard:** For composite wall assemblies, gypsum wallboard must be a minimum of <sup>5</sup>/<sub>8</sub> inch (15.9 mm) thick and Type X, complying with ASTM C1396 and manufactured by one of the following companies: American Gypsum; CertainTeed; Georgia Pacific; Lafarge; National Gypsum; or USG. For non-composited wall assemblies, the gypsum wallboard is allowed to be any gypsum wallboard allowed by the applicable code.

**3.2.3 Fasteners:** Fasteners for attaching the gypsum wallboard to the studs and tracks must be No. 6, Type S, fine thread drywall bugle head screws conforming to ASTM C1002. Fasteners for attaching the stud to the top slotted flange track must be No. 8 self-piercing screws with minimum head diameter of 0.4 inches (Phillips truss head or pan head).

## 4.0 DESIGN AND INSTALLATION

### 4.1 Design:

Allowable wall heights for interior nonload-bearing composite wall design are shown in [Table 3](#).

Allowable wall heights for interior nonload-bearing non-composite wall design are shown in [Tables 5](#) and [6](#).

Allowable spans for ceiling framing are shown in [Table 7](#).

Spans noted in [Tables 5](#), [6](#), and [7](#) are based on the section properties noted in [Table 4](#).

### 4.2 Installation:

Installation of ViperStud studs and tracks must be in accordance with the approved plans and this report. The approved plans must be available on the jobsite at all times during installation.

**4.2.1** For composite system walls, fastening of studs to tracks is optional, except when a slotted flange top track is used. The stud must be fastened to the slotted track through the slot mid-length using #8 self-piercing screws. End bearing of the stud on the track must be a minimum of 1 inch (25 mm) for solid flange tracks (xxxVT125 tracks) and <sup>1</sup>/<sub>8</sub> inches (41.3 mm) for slotted flange tracks (xxxCST250 or xxxSLT250 tracks).

Gypsum wallboard must be installed on both sides of the wall framing for the full wall height, with the long dimension of the gypsum wallboard parallel to the studs. Placement of joints in the gypsum sheathing must be in accordance with Section 4.6 of GA-216-21 (Gypsum Association Application and Finishing of Gypsum Panel Products) or Section 7.5 of ASTM C840.

Maximum spacing of fasteners fastening the gypsum wallboard to the studs and tracks must be as follows:

STUD SPACING	STUDS	TRACKS
12" o.c.	16" o.c.	16" o.c.
16" o.c.	16" o.c.	16" o.c.
24" o.c.	12" o.c.	12" o.c.

For SI: 1 inch = 25.4 mm.

**Exception:** Gypsum wallboard fastening to slotted flange top tracks (xxxCST250 or xxxSLT250) is not required.

**4.2.2** Sheathing used with ceiling framing and non-composite system walls must be installed in accordance with the applicable code requirements for the sheathing material.

## 5.0 CONDITIONS OF USE:

The ViperStud studs and tracks described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 Installation must comply with the approved plans and this report. In the event of a conflict, this report governs.
- 5.2 The interior nonload-bearing wall assemblies are limited to interior installations where the superimposed axial load is zero pounds.
- 5.3 Design of the attachment of the wall to the surrounding structure is outside the scope of this report.
- 5.4 Installation of the gypsum wallboard must meet the requirements of ASTM C840 or GA-216.
- 5.5 Use of ViperStud studs and tracks in other than non-structural applications, as defined by AISI S220, is outside the scope of this report.
- 5.6 Complete construction documents and calculations verifying compliance with this report must be submitted to the code official for each project. The calculations and construction documents must be prepared and sealed by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.7 ViperStud studs and tracks described in this report are manufactured under an approved quality control program with inspections by ICC-ES.

## 6.0 EVIDENCE SUBMITTED

- 6.1 Data in accordance with the [ICC-ES Acceptance Criteria for Cold-formed Steel Framing Members \(AC46\)](#), dated October 2019 and editorially revised February 2024.
- 6.2 Data in accordance with the [ICC-ES Acceptance Criteria for Cold-formed Steel Framing Members—Interior Nonload-bearing Wall Assemblies \(AC86\)](#), dated June 2019 and editorially revised February 2024.

## 7.0 IDENTIFICATION

- 7.1 Each ViperStud stud and track covered by this report must have a legible label or stamp, at a maximum spacing of 96 inches (2438 mm) on center, indicating the manufacturer's name or initials [MarinoWARE (MW), CEMCO, or Imperial Building Products]; the minimum bare metal thickness in mils or inches; the minimum yield strength in ksi (if other than 33 ksi); the coating designation (if other than G40); the designation "NS"; and the evaluation report number (ESR-2620).
- 7.2 The report holder's contact information is the following:

**WARE INDUSTRIES, INC. (dba MarinoWARE)**  
**400 METUCHEN ROAD**  
**SOUTH PLAINFIELD, NEW JERSEY 07080**  
**(908) 757-9000**  
[www.marinoware.com](http://www.marinoware.com)

7.3 The additional listees' information is the following:

**CEMCO, LLC**  
**263 NORTH COVINA LANE**  
**CITY OF INDUSTRY, CALIFORNIA 91746**  
**(800) 775-2362**  
[www.cemcosteel.com](http://www.cemcosteel.com)

**IMPERIAL BUILDING PRODUCTS**  
**4500, BERNARD-LEFEBVRE STREET**  
**LAVAL, QUEBEC H7C 0A5**  
**(450) 728-4500**

**TABLE 1—MANUFACTURING LOCATIONS**

MARINOWARE	CEMCO	IMPERIAL BUILDING PRODUCTS
South Plainfield, NJ 07080	City of Industry, CA 91746	Quebec, Canada H7C 0A5
Griffin, GA 30223	Pittsburg, CA 94565	Ontario, Canada L6T 5V8
East Chicago, IN 46312	Denver, CO 80204	
	Fort Worth, TX 76140	

**TABLE 2—MEMBER THICKNESS**

MEMBER (name)	STUD ID <sup>1</sup>	TRACK ID <sup>1</sup>		MINIMUM YIELD STRENGTH (ksi) <sup>4</sup>
		Solid Flange	Slotted Flange <sup>3</sup>	
Viper25	xxxVS125-15	xxxVT125-15	xxxSLT250-18 or xxxCST250-18	50 (stud and solid flange track) 70 (slotted flange track)
Viper20	xxxVS125-18	xxxVT125-18	xxxSLT250-18 or xxxCST250-18	70 (stud and slotted flange track) 50 (solid flange track)
Viper20D (1.625 – 3.625) <sup>2</sup>	xxxVS125-20	xxxVT125-20	xxxSLT250-18 or xxxCST250-18	57 (stud) 50 (solid flange track) 70 (slotted flange track)
Viper20D (4.00 – 6.00) <sup>2</sup>	xxxVS125-21	xxxVT125-21	xxxSLT250-18 or xxxCST250-18	57 (stud) 50 (solid flange track) 70 (slotted flange track)
Viper 18mil	xxxVS125-18	xxxVT125-18	xxxSLT250-27 or xxxCST250-27	33 (stud and solid flange track) 33 (slotted flange track)
Viper 27mil	xxxVS125-27	xxxVT125-27	xxxSLT250-27 or xxxCST250-27	33 (stud and solid flange track) 33 (slotted flange track)
Viper 30mil	xxxVS125-30	xxxVT125-30	xxxSLT250-30 or xxxCST250-30	33 (stud and solid flange track) 33 (slotted flange track)
Viper 33mil	xxxVS125-33	xxxVT125-33	xxxSLT250-33 or xxxCST250-33	33 (stud and solid flange track) 33 (slotted flange track)

For SI: 1 inch = 25.4 mm, 1 ksi = 6.895 MPa.

<sup>1</sup>xxx is the web size in 1/100 of an inch. The top track is solid flange track or slotted flange track. The bottom track is always solid flange track.

<sup>2</sup>Applicable range of depths, in inches, for the member.

<sup>3</sup>Tracks with slotted flanges are available with a web depth (measured from inside flange to inside flange) of 2.5 - 6.0 inches. Their use is limited to top tracks and as specified in Footnote 6 of [Table 3](#).

<sup>4</sup>The minimum yield strength corresponds to the grade of steel noted in Section 3.2.1.

TABLE 3—COMPOSITE WALL LIMITING HEIGHTS<sup>1,2,3,4,5</sup> (ft-in)

DEPTH (in)	MEMBER (name) (STUD SECTION ID)	SPACING (in)	5 psf			7.5 psf			10 psf		
			L <sub>/120</sub>	L <sub>/240</sub>	L <sub>/360</sub>	L <sub>/120</sub>	L <sub>/240</sub>	L <sub>/360</sub>	L <sub>/120</sub>	L <sub>/240</sub>	L <sub>/360</sub>
1 <sup>5</sup> / <sub>8</sub> <sup>6</sup>	Viper25 (162VS125-15)	12	13-9	11-4	9-10	12-0	9-11	8-3	10-11	8-10	----
		16	12-6	10-4	8-8	10-11	8-10	----	9-11	7-11	----
		24	10-11	8-10	----	9-5	----	----	8-2	----	----
	Viper20 (162VS125-18)	12	13-10	11-0	9-7	12-1	9-7	8-5	11-0	8-9	----
		16	12-7	10-0	8-9	11-0	8-9	7-11	10-0	7-11	----
		24	11-0	8-9	----	9-7	----	----	8-9	----	----
	Viper20D (162VS125-20)	12	14-3	11-3	9-10	12-5	9-10	8-5	11-3	8-10	----
		16	12-11	10-3	8-10	11-3	8-10	----	10-3	7-11	----
		24	11-3	8-10	----	9-10	----	----	8-10	----	----
	Viper 18mil (162VS125-18)	12	12-10	10-7	9-4	11-3	9-3	8-2	10-3	8-5	----
		16	11-9	9-8	8-6	10-3	8-5	----	9-4	----	----
		24	10-3	8-5	----	8-0	----	----	8-2	----	----
	Viper 27mil (162VS125-27)	12	14-4	11-5	9-11	12-6	9-11	8-5	11-5	8-10	----
		16	13-0	10-4	8-10	11-5	8-10	----	10-4	7-10	----
		24	11-5	8-10	----	9-10	----	----	8-6	----	----
	Viper 30mil (162VS125-30)	12	14-7	11-6	10-0	12-9	10-0	8-6	11-7	8-11	----
		16	13-3	10-5	8-11	11-7	8-11	----	10-6	7-10	----
		24	11-7	8-11	----	10-1	----	----	8-10	----	----
	Viper 33mil (162VS125-33)	12	14-11	11-10	10-4	13-0	10-4	8-10	11-10	9-4	7-11
		16	13-6	10-9	9-4	11-10	9-4	7-11	10-9	8-4	----
		24	11-10	9-4	7-11	10-4	7-11	----	9-4	----	----
2 <sup>1</sup> / <sub>2</sub>	Viper25 (250VS125-15)	12	17-3	14-5	12-9	15-0	12-7	11-1	13-8	11-6	10-1
		16	15-8	13-1	11-7	13-8	11-6	10-1	12-3	10-5	8-9
		24	13-8	11-6	10-1	11-6	10-0	8-2	10-0	8-8	----
	Viper20 (250VS125-18)	12	18-2	14-5	12-7	15-10	12-7	11-0	14-5	11-5	9-10
		16	16-6	13-1	11-5	14-5	11-5	9-10	13-1	10-4	8-10
		24	14-5	11-5	9-10	12-7	9-10	8-5	11-5	8-10	----
	Viper20D (250VS125-20)	12	17-11	14-10	13-2	5-8	13-0	11-6	14-3	11-10	10-5
		16	16-4	13-6	12-0	14-3	11-10	10-5	12-11	10-9	9-4
		24	14-3	11-10	10-5	12-5	10-4	8-9	11-3	9-2	----
	Viper 18mil (250VS125-18)	12	17-5	14-5	12-7	14-7	12-7	11-0	12-8	11-5	9-8
		16	15-6	13-1	11-6	12-8	11-6	9-8	8-11	8-6	----
		24	12-7	11-5	9-8	10-4	9-8	8-0	8-11	8-6	----
	Viper 27mil (250VS125-27)	12	18-3	14-5	12-8	15-11	12-8	11-0	14-4	11-6	10-0
		16	16-7	13-2	11-6	14-4	11-6	10-0	12-5	10-5	8-11
		24	14-4	11-6	10-0	11-9	10-0	8-6	10-2	8-11	----
	Viper 30mil (250VS125-30)	12	18-9	14-10	13-0	16-4	13-0	11-4	14-10	11-10	10-4
		16	17-0	13-6	11-10	14-10	11-10	10-4	13-6	10-9	9-3
		24	14-10	11-10	10-4	12-9	10-4	8-10	11-0	9-3	7-10
	Viper 33mil (250VS125-33)	12	19-4	15-4	13-5	16-10	13-5	11-8	15-4	12-2	10-8
		16	17-7	13-11	12-2	15-4	12-2	10-8	13-11	11-0	9-8
		24	15-4	12-2	10-8	13-5	10-8	9-2	12-0	9-8	8-2
3 <sup>5</sup> / <sub>8</sub>	Viper25 (362VS125-15)	12	20-10	17-3	15-2	18-2	15-1	13-3	15-10	13-9	12-0
		16	18-11	15-9	13-9	15-10	13-9	12-0	13-9	12-6	10-11
		24	15-10	13-9	12-0	12-11	12-0	10-6	11-3	10-11	9-6
	Viper20 (362VS125-18)	12	21-11	18-0	15-10	19-1	15-9	13-10	17-5	14-3	12-7
		16	19-11	16-4	14-5	17-5	14-3	12-7	15-10	13-0	11-4
		24	17-5	14-3	12-7	15-2	12-6	10-10	13-10	11-3	9-9
	Viper20D (362VS125-20)	12	21-10	17-11	15-9	19-1	15-8	13-9	17-4	14-3	12-6
		16	19-10	16-4	14-4	17-4	14-3	12-6	15-4	12-11	11-4
		24	17-4	14-3	12-6	14-6	12-5	10-11	12-7	11-4	9-11
	Viper 18mil (362VS125-18)	12	18-7	15-11	13-11	17-8	15-4	13-5	15-3	13-11	12-2
		16	18-9	15-11	13-11	15-3	13-11	12-2	13-3	12-8	10-11
		24	15-3	13-11	12-2	12-6 <sup>6</sup>	12-2	10-6	10-10 <sup>6</sup>	10-10 <sup>6</sup>	9-5 <sup>6</sup>
	Viper 27mil (362VS125-27)	12	22-9	18-1	15-10	19-11	15-10	13-10	17-7	14-4	12-6
		16	20-8	16-5	14-4	17-7	14-4	12-6	15-3	13-0	11-2
		24	17-7	14-4	12-5	14-4 <sup>6</sup>	12-6	10-8	12-5 <sup>6</sup>	11-2 <sup>6</sup>	----
	Viper 30mil (362VS125-30)	12	23-3	18-6	16-2	20-4	16-2	14-1	18-6	14-8	12-10
		16	21-2	16-9	14-8	18-6	14-8	12-10	16-4	13-4	11-6
		24	18-6	14-8	12-10	15-4	12-10	11-0	13-4 <sup>6</sup>	11-6	9-11
	Viper 33mil (362VS125-33)	12	23-10	18-11	16-6	20-10	16-6	14-5	18-11	15-0	13-1
		16	21-8	17-2	15-0	18-11	15-0	13-1	17-2	13-8	11-10
		24	18-11	15-0	13-1	16-6	13-1	11-4	14-4 <sup>6</sup>	11-10	10-3

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa

(To be continued)

TABLE 3—COMPOSITE WALL LIMITING HEIGHTS<sup>1,2,3,4,5</sup> (ft-in) – Continued

DEPTH (in)	MEMBER (name) (STUD SECTION ID)	SPACING (in)	5 psf			7.5 psf			10 psf		
			L <sub>120</sub>	L <sub>240</sub>	L <sub>360</sub>	L <sub>120</sub>	L <sub>240</sub>	L <sub>360</sub>	L <sub>120</sub>	L <sub>240</sub>	L <sub>360</sub>
4	Viper25 (400VS125-15)	12	22-1	18-3	16-3	19-3	15-11	14-2	16-8	14-6	12-11
		16	20-0	16-7	14-9	16-8	14-6	12-11	14-5	13-2	11-9
		24	16-8	14-6	12-11	13-7	12-8	11-3	11-9	11-6	10-1
	Viper20 (400VS125-18)	12	22-11	18-11	16-8	20-0	16-7	14-7	18-2	15-1	13-3
		16	20-10	17-3	15-2	18-2	15-1	13-3	16-6	13-8	12-1
		24	18-2	15-1	13-3	15-10	13-2	11-7	14-5	11-11	10-5
	Viper20D (400VS125-21)	12	24-0	19-1	16-8	21-0	16-8	14-7	19-1	15-2	13-3
		16	21-10	17-4	15-2	19-1	15-2	13-3	17-4	13-9	12-0
		24	19-1	15-2	13-3	16-8	13-3	11-7	14-11	12-0	10-5
	Viper 18mil (400VS125-18)	12	20-6	18-5	16-3	16-9	16-1	14-2	14-6	14-6	12-11
		16	17-9	16-9	14-9	14-6	14-6	12-11	12-7	12-7	11-9
		24	14-6	14-6	12-11	11-10 <sup>6</sup>	11-10	11-2	10-3 <sup>6</sup>	10-3 <sup>6</sup>	9-11 <sup>6</sup>
	Viper 27mil (400VS125-27)	12	24-9	19-8	17-2	20-7	17-2	15-0	17-10	15-7	13-8
		16	21-10	17-11	15-7	17-10	15-7	13-8	15-5	14-2	12-4
		24	17-10	15-7	13-8	14-7 <sup>6</sup>	13-8	11-10	12-7 <sup>6</sup>	12-4 <sup>6</sup>	10-9 <sup>6</sup>
	Viper 30mil (400VS125-30)	12	25-2	20-0	17-6	22-0	17-6	15-3	19-5	15-11	13-10
		16	22-11	18-2	15-11	19-5	15-11	13-10	16-10	14-5	12-7
		24	19-5	15-11	13-10	15-10	13-10	12-1	13-9 <sup>6</sup>	12-7	10-11
	Viper 33mil (400VS125-33)	12	25-8	20-4	17-10	22-5	17-10	15-7	20-4	16-2	14-1
		16	23-4	18-6	16-2	20-4	16-2	14-1	18-4	14-8	12-10
		24	20-4	16-2	14-1	17-3	14-2	12-4	15-0 <sup>6</sup>	12-10	11-2
6	Viper25 (600VS125-15)	12	24-8	23-9	21-1	22-3	20-9	18-5	20-0	18-10	16-9
		16	22-11	21-7	19-2	20-0	18-10	16-9	17-5	17-2	15-3
		24	20-0	18-10	16-9	16-5	16-5	14-8	14-2	14-2	13-0
	Viper20 (600VS125-18)	12	30-6	26-0	23-0	26-7	22-9	20-1	24-2	20-8	18-4
		16	27-8	23-7	20-11	24-2	20-8	18-4	21-12	18-9	16-8
		24	24-2	20-8	18-4	20-11	18-0	16-0	18-1	16-5	14-7
	Viper20D (600VS125-21)	12	29-1	25-7	22-6	25-10	22-4	19-8	23-8	20-4	17-11
		16	26-9	23-3	20-6	23-8	20-4	17-11	21-9	18-6	16-3
		24	23-8	20-4	17-11	20-11	17-9	15-7	18-2	16-2	14-2
	Viper 18mil (600VS125-18)	12	25-5	24-9	21-8	20-9	20-9	18-11	18-0	18-0	17-2
		16	22-0	22-0	19-8	18-0	18-0	17-2	15-7 <sup>6</sup>	15-7 <sup>6</sup>	15-7 <sup>6</sup>
		24	18-0	18-0	17-2	14-8 <sup>6</sup>	14-8 <sup>6</sup>	14-8 <sup>6</sup>	12-9 <sup>6</sup>	12-9 <sup>6</sup>	12-9 <sup>6</sup>
	Viper 27mil (600VS125-27)	12	29-7	25-11	22-8	24-2	22-8	19-9	20-11	20-7	18-0
		16	25-7	23-6	20-7	20-11	20-7	18-0	18-1 <sup>6</sup>	18-1 <sup>6</sup>	16-4 <sup>6</sup>
		24	20-11	20-7	18-0	17-1 <sup>6</sup>	17-1 <sup>6</sup>	15-8 <sup>6</sup>	14-9 <sup>6</sup>	14-9 <sup>6</sup>	14-2 <sup>6</sup>
	Viper 30mil (600VS125-30)	12	31-10	26-9	23-4	26-0	23-4	20-5	22-6	21-3	18-6
		16	27-7	24-3	21-3	22-6	21-3	18-6	19-6 <sup>6</sup>	19-3 <sup>6</sup>	16-10
		24	22-6	21-3	18-6	18-5 <sup>6</sup>	18-5 <sup>6</sup>	16-2	15-11 <sup>6</sup>	15-11 <sup>6</sup>	14-8 <sup>6</sup>
	Viper 33mil (600VS125-33)	12	34-5	27-7	24-1	28-1	24-1	21-1	24-4	21-11	19-2
		16	29-10	25-1	21-11	24-4	21-11	19-2	21-1 <sup>6</sup>	19-11	17-5
		24	24-4	21-11	19-2	19-11 <sup>6</sup>	19-2 <sup>6</sup>	16-9	17-2 <sup>6</sup>	17-2 <sup>6</sup>	15-2 <sup>6</sup>

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa

<sup>1</sup>Sheathing, as specified in Section 3.2.2, must be attached to both faces of the wall for the full height of the wall with the long dimension parallel to the studs.

<sup>2</sup>Sheathing must be fastened to the studs with fasteners as specified in Section 3.2.3 and installed per Section 4.2.1.

<sup>3</sup>Placement of joints in the gypsum sheathing must be in accordance with Section 4.6 of GA-216 or Section 7.5 of ASTM C840.

<sup>4</sup>The bottom and top tracks are xxxVT125 (solid flange track). Slotted flange track (xxxCST250 or xxxSLT250) may be used for the top track except as specified in Footnote 6.

<sup>5</sup>End bearing must be a minimum of 1 inch for xxxVT125 (solid flange track) and 1<sup>5</sup>/<sub>8</sub> inches for xxxCST250 or xxxSLT250 (slotted flange track).

<sup>6</sup>Slotted flange tracks are not allowed for these heights and are outside the scope of this report.

TABLE 4—STUD SECTION PROPERTIES

MEMBER (name)	STUD SECTION ID	MIL THICKNESS (mils)	WEIGHT (lb/ft)	GROSS					EFFECTIVE		MOMENTS			CRITICAL UNBRACED LENGTH
				Area (in <sup>2</sup> )	I <sub>x</sub> (in <sup>4</sup> )	r <sub>x</sub> (in)	I <sub>y</sub> (in <sup>4</sup> )	r <sub>y</sub> (in)	I <sub>xd</sub> (in <sup>4</sup> )	S <sub>x</sub> (in <sup>3</sup> )	ALLOWABLE MOMENT <sup>3</sup>  M <sub>a</sub> (in-k)	LOCAL BUCKLING NOMINAL MOMENT  M <sub>nl</sub> (in-k)	DISTORTIONAL BUCKLING NOMINAL MOMENT  M <sub>nd</sub> (in-k)	
Viper25	162VS125-15	15	0.242	0.071	0.0320	0.671	0.0151	0.461	0.0322	0.0258	0.663	1.42	1.20	25.1
	250VS125-15	15	0.289	0.085	0.0844	0.998	0.0173	0.452	0.0903	0.0423	1.170	2.72	2.12	24.8
	362VS125-15 <sup>1</sup>	15	0.348	0.102	0.1990	1.390	0.0193	0.435	0.2050	0.0580	1.600	3.48	2.90	24.5
	400VS125-15 <sup>1</sup>	15	0.367	0.108	0.2500	1.520	0.0198	0.429	0.2550	0.0612	1.690	3.99	3.06	24.4
	600VS125-15 <sup>2</sup>	15	0.473	0.139	0.6590	2.180	0.0219	0.397	0.6280	0.0854	2.360	5.90	4.27	23.7
Viper20	162VS125-18	19	0.285	0.0839	0.0391	0.683	0.0179	0.462	0.0328	0.0285	1.19	1.99	2.02	21.2
	250VS125-18	19	0.351	0.103	0.106	1.01	0.0227	0.469	0.0942	0.0581	2.09	4.07	3.49	21.9
	362VS125-18	19	0.423	0.124	0.249	1.42	0.0256	0.454	0.213	0.0755	3.08	5.28	5.14	21.5
	400VS125-18	19	0.449	0.132	0.315	1.55	0.0266	0.449	0.265	0.0847	3.44	5.93	5.74	21.5
	600VS125-18	19	0.586	0.172	0.846	2.22	0.0319	0.430	0.647	0.151	5.41	10.6	9.04	21.5
Viper20D	162VS125-20	20	0.315	0.093	0.0419	0.673	0.0195	0.459	0.0498	0.0403	1.270	2.74	2.14	23.4
	250VS125-20	20	0.376	0.111	0.1110	1.000	0.0225	0.451	0.1290	0.0651	2.050	4.50	3.71	23.1
	362VS125-20	20	0.454	0.134	0.2610	1.400	0.0251	0.433	0.2980	0.0904	2.850	6.10	5.15	22.8
	400VS125-21	21	0.515	0.152	0.3520	1.520	0.0275	0.426	0.3770	0.1170	3.690	8.02	6.67	22.7
	600VS125-21 <sup>2</sup>	21	0.665	0.196	0.9290	2.180	0.0304	0.394	0.8690	0.1610	5.060	11.20	9.16	22.0

For SI: 1 plf = 14.5939 N/m, 1 inch = 25.4 mm, 1 inch<sup>2</sup> = 645.16 mm<sup>2</sup>, 1 inch<sup>3</sup> = 16,387.064 mm<sup>3</sup>, 1 inch<sup>4</sup> = 416,231 mm<sup>4</sup>, 1 lb = 0.4536 kg, 1 kip-in = 112.99 N-m. See next page for notes.

(To be continued)

TABLE 4—STUD SECTION PROPERTIES (Continued)

MEMBER (name)	STUD SECTION ID	MIL THICKNESS (mils)	WEIGHT (lb/ft)	GROSS					EFFECTIVE		MOMENTS			CRITICAL UNBRACED LENGTH
				Area (in <sup>2</sup> )	I <sub>x</sub> (in <sup>4</sup> )	r <sub>x</sub> (in)	I <sub>y</sub> (in <sup>4</sup> )	r <sub>y</sub> (in)	I <sub>xd</sub> (in <sup>4</sup> )	S <sub>x</sub> (in <sup>3</sup> )	ALLOWABLE MOMENT <sup>3</sup>	LOCAL BUCKLING NOMINAL MOMENT	DISTORTIONAL BUCKLING NOMINAL MOMENT	
Viper 27mil	162VS125-27	27	0.417	0.123	0.0569	0.682	0.0254	0.456	0.0560	0.0586	1.160	1.93	2.10	30.7
	250VS125-27	27	0.506	0.149	0.1510	1.010	0.0299	0.449	0.1480	0.1060	2.030	3.49	3.39	30.2
	362VS125-27	27	0.611	0.180	0.3560	1.410	0.0335	0.432	0.3500	0.1480	2.930	4.89	5.11	29.8
	400VS125-27	27	0.645	0.190	0.4490	1.540	0.0344	0.426	0.4410	0.1650	3.260	5.45	5.69	29.6
	600VS125-27 <sup>1</sup>	27	0.838	0.246	1.1900	2.200	0.0382	0.394	1.1000	0.2900	5.150	9.65	8.59	28.8
Viper 30mil	162VS125-30	30	0.459	0.135	0.0623	0.680	0.0279	0.455	0.0615	0.0670	1.320	2.21	2.38	30.8
	250VS125-30	30	0.547	0.161	0.1660	1.020	0.0323	0.448	0.1630	0.1200	2.310	3.96	3.86	30.1
	362VS125-30	30	0.669	0.197	0.3910	1.410	0.0366	0.431	0.3850	0.1720	3.390	5.67	5.85	29.7
	400VS125-30	30	0.711	0.209	0.4930	1.540	0.0377	0.425	0.4860	0.1910	3.780	6.31	6.52	29.6
	600VS125-30	30	0.924	0.271	1.3100	2.190	0.0418	0.392	1.2300	0.3410	5.950	11.30	9.93	28.7
Viper 33mil	162VS125-33	33	0.500	0.147	0.0686	0.683	0.0302	0.453	0.0681	0.0773	1.530	2.55	2.71	30.8
	250VS125-33	33	0.606	0.178	0.1830	1.010	0.0356	0.447	0.1810	0.1370	2.650	4.53	4.42*	30.1
	362VS125-33	33	0.748	0.220	0.4320	1.400	0.0404	0.429	0.4280	0.2010	3.960	6.62	6.75	29.7
	400VS125-33	33	0.783	0.230	0.5440	1.540	0.0413	0.424	0.5390	0.2240	4.420	7.38	7.53	29.5
	600VS125-33	33	1.023	0.301	1.4400	2.190	0.0459	0.391	1.3900	0.4000	6.930	13.20	11.6	28.6

For SI: 1 plf = 14.5939 N/m, 1 inch = 25.4 mm, 1 inch<sup>2</sup> = 645.16 mm<sup>2</sup>, 1 inch<sup>3</sup> = 16,387.064 mm<sup>3</sup>, 1 inch<sup>4</sup> = 416,231 mm<sup>4</sup>, 1 lb = 0.4536 kg, 1 kip-in = 112.99 N-m.

<sup>1</sup>Web depth-to-thickness ratio exceeds 200.

<sup>2</sup>Web depth-to-thickness ratio exceeds 260.

<sup>3</sup>The allowable moment is the lesser of the allowable local buckling moment and allowable distortional buckling moment. K<sub>φ</sub> is assumed to be zero for distortional buckling moments.

**SYMBOLS**

I<sub>x</sub> = Strong axis moment of inertia

r<sub>x</sub> = Strong axis radius of gyration

I<sub>y</sub> = Weak axis moment of inertia

r<sub>y</sub> = Weak axis radius of gyration

I<sub>xd</sub> = Effective Strong axis moment of inertia

S<sub>x</sub> = Effective Strong axis section modulus

M<sub>a</sub> = Strong axis allowable bending moment (inclusive of safety factor) based on the critical unbraced length less than or equal to that tabulated.

M<sub>nl</sub> = Nominal moment based on local buckling

M<sub>nd</sub> = Nominal moment based on distortional buckling

L<sub>u</sub> = Maximum unbraced length at which the member is considered to be fully braced for design purposes.

K<sub>φ</sub> = Rotational stiffness



TABLE 5—LIMITING HEIGHTS FOR FULLY BRACED<sup>1</sup> NON-COMPOSITE WALLS

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf				
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	
VIPER25	162VS125-15	12	9'-5"	8'-4"	7'-6"	6'-7"	7'-8"	7'-2"	6'-7"	--	6'-7"	6'-7"	6'-0"	--	
		16	8'-1"	7'-6"	6'-10"	6'-0"	6'-7"	6'-7"	6'-0"	--	--	--	--	--	
		24	6'-7"	6'-7"	6'-0"	--	--	--	--	--	--	--	--	--	
	250VS125-15	12	12'-6"	11'-7"	10'-7"	9'-2"	10'-2"	10'-2"	9'-2"	8'-1"	8'-10"	8'-10"	8'-5"	7'-4"	
		16	10'-10"	10'-7"	9'-7"	8'-5"	8'-10"	8'-10"	8'-5"	7'-4"	7'-8"	7'-8"	7'-7"	6'-8"	
		24	8'-10"	8'-10"	8'-5"	7'-4"	7'-1"	7'-1"	7'-1"	6'-5"	--	--	--	--	
	362VS125-15	12	14'-7"	14'-7"	13'-11"	12'-1"	11'-11"	11'-11"	11'-11"	10'-7"	10'-4"	10'-4"	10'-4"	9'-7"	
		16	12'-8"	12'-8"	12'-7"	11'-0"	10'-4"	10'-4"	10'-4"	9'-7"	9'-0"	9'-0"	9'-0"	8'-10"	
		24	10'-4"	10'-4"	10'-4"	9'-7"	8'-5"	8'-5"	8'-5"	8'-5"	6'-7"	6'-7"	6'-7"	6'-7"	
	400VS125-15	12	15'-0"	15'-0"	15'-0"	13'-1"	12'-4"	12'-4"	12'-4"	11'-5"	10'-7"	10'-7"	10'-7"	10'-5"	
		16	13'-0"	13'-0"	13'-0"	11'-11"	10'-7"	10'-7"	10'-7"	10'-5"	9'-2"	9'-2"	9'-2"	9'-2"	
		24	10'-7"	10'-7"	10'-7"	10'-5"	8'-6"	8'-6"	8'-6"	8'-6"	6'-5"	6'-5"	6'-5"	6'-5"	
	600VS125-15	12	17'-8"	17'-8"	17'-8"	17'-7"	14'-1"	14'-1"	14'-1"	14'-1"	10'-7"	10'-7"	10'-7"	10'-7"	
		16	15'-5"	15'-5"	15'-5"	15'-5"	10'-7"	10'-7"	10'-7"	10'-7"	7'-11"	7'-11"	7'-11"	7'-11"	
		24	10'-7"	10'-7"	10'-7"	10'-7"	7'-0"	7'-0"	7'-0"	7'-0"	--	--	--	--	
	Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf			
				L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360
	VIPER20	162VS125-18	12	9'-6"	---	7'-7"	6'-7"	8'-4"	---	6'-7"	5'-10"	7'-7"	---	6'-0"	5'-2"
16			8'-7"	---	6'-11"	6'-0"	7'-7"	---	6'-0"	5'-2"	6'-11"	---	5'-5"	4'-10"	
24			7'-7"	---	6'-0"	5'-2"	6'-7"	---	5'-2"	4'-7"	6'-0"	---	4'-10"	4'-2"	
250VS125-18		12	13'-6"	---	10'-8"	9'-5"	11'-10"	---	9'-5"	8'-2"	10'-8"	---	8'-6"	7'-5"	
		16	12'-4"	---	9'-8"	8'-6"	10'-8"	---	8'-6"	7'-5"	9'-8"	---	7'-8"	6'-10"	
		24	10'-8"	---	8'-6"	7'-5"	9'-5"	---	7'-5"	6'-6"	8'-4"	---	6'-10"	5'-11"	
362VS125-18		12	17'-8"	---	14'-1"	12'-4"	15'-6"	---	12'-4"	10'-8"	14'-1"	---	11'-2"	9'-10"	
		16	16'-1"	---	12'-10"	11'-2"	14'-1"	---	11'-2"	9'-10"	12'-5"	---	10'-1"	8'-11"	
		24	14'-1"	---	11'-2"	9'-10"	11'-8"	---	9'-10"	8'-6"	10'-1"	---	8'-11"	7'-8"	
400VS125-18		12	19'-1"	---	15'-1"	13'-2"	16'-8"	---	13'-2"	11'-7"	15'-1"	---	12'-0"	10'-6"	
		16	17'-4"	---	13'-10"	12'-0"	15'-1"	---	12'-0"	10'-6"	13'-1"	---	10'-11"	9'-6"	
		24	15'-1"	---	12'-0"	10'-6"	12'-5"	---	10'-6"	9'-2"	10'-8"	---	9'-6"	8'-4"	
600VS125-18		12	25'-8"	---	20'-5"	17'-10"	21'-11"	---	17'-10"	15'-7"	19'-0"	---	16'-2"	14'-1"	
		16	23'-4"	---	18'-6"	16'-2"	19'-0"	---	16'-2"	14'-1"	15'-10"	---	14'-8"	12'-10"	
		24	19'-0"	---	16'-2"	14'-1"	14'-0"	---	14'-0"	12'-5"	10'-6"	---	10'-6"	10'-6"	

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.

<sup>1</sup>Bracing is required at internals not exceeding maximum unbraced length (L<sub>u</sub>) listed in Table 4.

(To be continued)

TABLE 5—LIMITING HEIGHTS FOR FULLY BRACED<sup>1</sup> NON-COMPOSITE WALLS (Continued)

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf				
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	
VIPER20D	162VS125-20	12	10'-11"	9'-6"	8'-8"	7'-7"	9'-6"	8'-4"	7'-7"	6'-7"	8'-8"	7'-7"	6'-11"	6'-0"	
		16	9'-11"	8'-8"	7'-11"	6'-11"	8'-8"	7'-7"	6'-11"	6'-0"	7'-8"	6'-11"	6'-4"	--	
		24	8'-8"	7'-7"	6'-11"	6'-0"	7'-2"	6'-7"	6'-0"	--	6'-4"	6'-0"	--	--	
	250VS125-20	12	15'-0"	13'-1"	11'-11"	10'-5"	13'-1"	11'-6"	10'-5"	9'-1"	11'-8"	10'-5"	9'-6"	8'-4"	
		16	13'-7"	11'-11"	10'-10"	9'-6"	11'-8"	10'-5"	9'-6"	8'-4"	10'-1"	9'-6"	8'-7"	7'-6"	
		24	11'-8"	10'-5"	9'-6"	8'-4"	9'-6"	9'-1"	8'-4"	7'-2"	8'-4"	8'-4"	7'-6"	6'-7"	
	362VS125-20	12	19'-6"	17'-4"	15'-10"	13'-10"	15'-11"	15'-1"	13'-10"	12'-0"	13'-10"	13'-10"	12'-6"	10'-11"	
		16	16'-11"	15'-10"	14'-4"	12'-6"	13'-10"	13'-10"	12'-6"	10'-11"	11'-11"	11'-11"	11'-5"	9'-11"	
		24	13'-10"	13'-10"	12'-6"	10'-11"	11'-2"	11'-2"	10'-11"	9'-6"	9'-8"	9'-8"	9'-8"	8'-8"	
	400VS125-21	12	21'-6"	18'-8"	17'-0"	14'-11"	18'-1"	16'-5"	14'-11"	13'-0"	15'-8"	14'-11"	13'-6"	11'-10"	
		16	19'-2"	17'-0"	15'-6"	13'-6"	15'-8"	14'-11"	13'-6"	11'-10"	13'-7"	13'-6"	12'-4"	10'-8"	
		24	15'-8"	14'-11"	13'-6"	11'-10"	12'-10"	12'-10"	11'-10"	10'-4"	11'-1"	11'-1"	10'-8"	9'-5"	
	600VS125-21	12	26'-0"	24'-10"	22'-6"	19'-8"	21'-2"	21'-2"	19'-8"	17'-2"	18'-5"	18'-5"	17'-11"	15'-7"	
		16	22'-6"	22'-6"	20'-5"	17'-11"	18'-5"	18'-5"	17'-11"	15'-7"	15'-11"	15'-11"	15'-11"	14'-2"	
		24	18'-5"	18'-5"	17'-11"	15'-7"	15'-0"	15'-0"	15'-0"	13'-7"	12'-1"	12'-1"	12'-1"	12'-1"	
	VIPER 27mil	162VS125-27	12	11'-5"	9'-11"	9'-0"	7'-11"	9'-11"	8'-8"	7'-11"	6'-11"	8'-10"	7'-11"	7'-2"	6'-4"
			16	10'-4"	9'-0"	8'-2"	7'-2"	8'-10"	7'-11"	7'-2"	6'-4"	7'-7"	7'-2"	6'-6"	--
			24	8'-10"	7'-11"	7'-2"	6'-4"	7'-2"	6'-11"	6'-4"	--	6'-2"	6'-2"	--	--
250VS125-27		12	15'-8"	13'-8"	12'-6"	10'-11"	13'-5"	12'-0"	10'-11"	9'-6"	11'-7"	10'-11"	9'-11"	8'-7"	
		16	14'-2"	12'-6"	11'-4"	9'-11"	11'-7"	10'-11"	9'-11"	8'-7"	10'-1"	9'-11"	9'-0"	7'-11"	
		24	11'-7"	10'-11"	9'-11"	8'-7"	9'-6"	9'-6"	8'-7"	7'-7"	8'-2"	8'-2"	7'-11"	6'-11"	
362VS125-27		12	19'-10"	18'-4"	16'-7"	14'-6"	16'-1"	16'-0"	14'-6"	12'-8"	14'-0"	14'-0"	13'-2"	11'-6"	
		16	17'-1"	16'-7"	15'-1"	13'-2"	14'-0"	14'-0"	13'-2"	11'-6"	12'-1"	12'-1"	12'-0"	10'-6"	
		24	14'-0"	14'-0"	13'-2"	11'-6"	11'-5"	11'-5"	11'-5"	10'-1"	9'-11"	9'-11"	9'-11"	9'-1"	
400VS125-27		12	20'-11"	19'-8"	17'-11"	15'-8"	17'-0"	17'-0"	15'-8"	13'-8"	14'-8"	14'-8"	14'-2"	12'-5"	
		16	18'-1"	17'-11"	16'-4"	14'-2"	14'-8"	14'-8"	14'-2"	12'-5"	12'-10"	12'-10"	12'-10"	11'-4"	
		24	14'-8"	14'-8"	14'-2"	12'-5"	12'-0"	12'-0"	12'-0"	10'-11"	10'-5"	10'-5"	10'-5"	9'-11"	
600VS125-27		12	26'-2"	26'-2"	24'-5"	21'-4"	21'-5"	21'-5"	21'-4"	18'-7"	18'-6"	18'-6"	18'-6"	16'-11"	
		16	22'-8"	22'-8"	22'-1"	19'-4"	18'-6"	18'-6"	18'-6"	16'-11"	15'-4"	15'-4"	15'-4"	15'-4"	
		24	18'-6"	18'-6"	18'-6"	16'-11"	13'-7"	13'-7"	13'-7"	13'-7"	10'-2"	10'-2"	10'-2"	10'-2"	

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.

<sup>1</sup>Bracing is required at internals not exceeding maximum unbraced length (L<sub>u</sub>) listed in Table 4.

(To be continued)

TABLE 5—LIMITING HEIGHTS FOR FULLY BRACED<sup>1</sup> NON-COMPOSITE WALLS (Continued)

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf				
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	
VIPER 30mil	162VS125-30	12	11'-8"	10'-2"	9'-4"	8'-1"	10'-2"	8'-11"	8'-1"	7'-1"	9'-4"	8'-1"	7'-5"	6'-6"	
		16	10'-8"	9'-4"	8'-6"	7'-5"	9'-4"	8'-1"	7'-5"	6'-6"	8'-1"	7'-5"	6'-8"	--	
		24	9'-4"	8'-1"	7'-5"	6'-6"	7'-8"	7'-1"	6'-6"	--	6'-7"	6'-6"	--	--	
	250VS125-30	12	16'-2"	14'-2"	12'-11"	11'-4"	14'-2"	12'-5"	11'-4"	9'-10"	12'-5"	11'-4"	10'-2"	8'-11"	
		16	14'-8"	12'-11"	11'-8"	10'-2"	12'-5"	11'-4"	10'-2"	8'-11"	10'-8"	10'-2"	9'-4"	8'-1"	
		24	12'-5"	11'-4"	10'-2"	8'-11"	10'-1"	9'-10"	8'-11"	7'-10"	8'-10"	8'-10"	8'-1"	7'-1"	
	362VS125-30	12	21'-4"	18'-11"	17'-2"	15'-0"	17'-5"	16'-6"	15'-0"	13'-1"	15'-0"	15'-0"	13'-7"	11'-11"	
		16	18'-5"	17'-2"	15'-7"	13'-7"	15'-0"	15'-0"	13'-7"	11'-11"	13'-0"	13'-0"	12'-5"	10'-10"	
		24	15'-0"	15'-0"	13'-7"	11'-11"	12'-4"	12'-4"	11'-11"	10'-5"	10'-7"	10'-7"	10'-7"	9'-5"	
	400VS125-30	12	22'-6"	20'-5"	18'-6"	16'-2"	18'-4"	17'-10"	16'-2"	14'-1"	15'-11"	15'-11"	14'-8"	12'-11"	
		16	19'-5"	18'-6"	16'-10"	14'-8"	15'-11"	15'-11"	14'-8"	12'-11"	13'-8"	13'-8"	13'-5"	11'-8"	
		24	15'-11"	15'-11"	14'-8"	12'-11"	13'-0"	13'-0"	12'-11"	11'-2"	11'-2"	11'-2"	11'-2"	10'-2"	
	600VS125-30	12	28'-2"	27'-10"	25'-4"	22'-1"	23'-0"	23'-0"	22'-1"	19'-4"	19'-11"	19'-11"	19'-11"	17'-6"	
		16	24'-5"	24'-5"	23'-0"	20'-1"	19'-11"	19'-11"	19'-11"	17'-6"	17'-2"	17'-2"	17'-2"	15'-11"	
		24	19'-11"	19'-11"	19'-11"	17'-6"	16'-4"	16'-4"	16'-4"	15'-4"	12'-5"	12'-5"	12'-5"	12'-5"	
	VIPER 33mil	162VS125-33	12	12'-1"	10'-7"	9'-7"	8'-5"	10'-7"	9'-4"	8'-5"	7'-4"	9'-7"	8'-5"	7'-7"	6'-8"
			16	11'-0"	9'-7"	8'-8"	7'-7"	9'-7"	8'-5"	7'-7"	6'-8"	8'-8"	7'-7"	6'-11"	6'-1"
			24	9'-7"	8'-5"	7'-7"	6'-8"	8'-2"	7'-4"	6'-8"	--	7'-1"	6'-8"	6'-1"	--
250VS125-33		12	16'-10"	14'-8"	13'-4"	11'-7"	14'-8"	12'-10"	11'-7"	10'-2"	13'-4"	11'-7"	10'-7"	9'-2"	
		16	15'-4"	13'-4"	12'-1"	10'-7"	13'-4"	11'-7"	10'-7"	9'-2"	11'-6"	10'-7"	9'-7"	8'-5"	
		24	13'-4"	11'-7"	10'-7"	9'-2"	10'-10"	10'-2"	9'-2"	8'-1"	9'-5"	9'-2"	8'-5"	7'-4"	
362VS125-33		12	22'-5"	19'-7"	17'-10"	15'-6"	18'-10"	17'-1"	15'-6"	13'-7"	16'-4"	15'-6"	14'-1"	12'-4"	
		16	19'-11"	17'-10"	16'-1"	14'-1"	16'-4"	15'-6"	14'-1"	12'-4"	14'-1"	14'-1"	12'-10"	11'-2"	
		24	16'-4"	15'-6"	14'-1"	12'-4"	13'-4"	13'-4"	12'-4"	10'-10"	11'-6"	11'-6"	11'-2"	9'-10"	
400VS125-33		12	24'-2"	21'-1"	19'-2"	16'-10"	19'-10"	18'-6"	16'-10"	14'-7"	17'-2"	16'-10"	15'-2"	13'-4"	
		16	21'-0"	19'-2"	17'-5"	15'-2"	17'-2"	16'-10"	15'-2"	13'-4"	14'-11"	14'-11"	13'-10"	12'-1"	
		24	17'-2"	16'-10"	15'-2"	13'-4"	14'-0"	14'-0"	13'-4"	11'-7"	12'-1"	12'-1"	12'-1"	10'-7"	
600VS125-33		12	30'-5"	28'-11"	26'-4"	23'-0"	24'-10"	24'-10"	23'-0"	20'-1"	21'-6"	21'-6"	20'-11"	18'-2"	
		16	26'-4"	26'-4"	23'-11"	20'-11"	21'-6"	21'-6"	20'-11"	18'-2"	18'-7"	18'-7"	18'-7"	16'-7"	
		24	21'-6"	21'-6"	20'-11"	18'-2"	17'-6"	17'-6"	17'-6"	15'-11"	15'-2"	15'-2"	15'-2"	14'-6"	

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa

<sup>1</sup>Bracing is required at internals not exceeding maximum unbraced length (L<sub>u</sub>) listed in Table 4.

TABLE 6—LIMITING HEIGHTS FOR NON-COMPOSITE WALLS BRACED 4 FEET ON CENTERS

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf			
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360
VIPER25	162VS125-15	12	8'-8"	8'-4"	7'-6"	6'-7"	7'-1"	7'-1"	6'-7"	--	6'-1"	6'-1"	6'-0"	--
		16	7'-6"	7'-6"	6'-10"	6'-0"	6'-1"	6'-1"	6'-0"	--	--	--	--	--
		24	6'-1"	6'-1"	6'-0"	--	--	--	--	--	--	--	--	--
	250VS125-15	12	11'-10"	11'-7"	10'-7"	9'-2"	9'-7"	9'-7"	9'-2"	8'-1"	8'-5"	8'-5"	8'-5"	7'-4"
		16	10'-2"	10'-2"	9'-7"	8'-5"	8'-5"	8'-5"	8'-5"	7'-4"	7'-2"	7'-2"	7'-2"	6'-8"
		24	8'-5"	8'-5"	8'-5"	7'-4"	6'-8"	6'-8"	6'-8"	6'-5"	--	--	--	--
	362VS125-15	12	13'-2"	13'-2"	13'-2"	12'-1"	10'-10"	10'-10"	10'-10"	10'-7"	9'-4"	9'-4"	9'-4"	9'-4"
		16	11'-5"	11'-5"	11'-5"	11'-0"	9'-4"	9'-4"	9'-4"	9'-4"	7'-10"	7'-10"	7'-10"	7'-10"
		24	9'-4"	9'-4"	9'-4"	9'-4"	6'-11"	6'-11"	6'-11"	6'-11"	--	--	--	--
	400VS125-15	12	13'-10"	13'-10"	13'-10"	13'-1"	11'-4"	11'-4"	11'-4"	11'-4"	9'-10"	9'-10"	9'-10"	9'-10"
		16	12'-0"	12'-0"	12'-0"	11'-11"	9'-10"	9'-10"	9'-10"	9'-10"	7'-5"	7'-5"	7'-5"	7'-5"
		24	9'-10"	9'-10"	9'-10"	9'-10"	6'-6"	6'-6"	6'-6"	6'-6"	--	--	--	--
	600VS125-15	12	14'-1"	14'-1"	14'-1"	14'-1"	9'-5"	9'-5"	9'-5"	9'-5"	7'-1"	7'-1"	7'-1"	7'-1"
		16	10'-7"	10'-7"	10'-7"	10'-7"	7'-1"	7'-1"	7'-1"	7'-1"	--	--	--	--
		24	7'-1"	7'-1"	7'-1"	7'-1"	--	--	--	--	--	--	--	--
Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf			
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360
VIPER20	162VS125-18	12	9'-6"	---	7'-7"	6'-7"	8'-4"	---	6'-7"	5'-10"	7'-5"	---	6'-0"	5'-2"
		16	8'-7"	---	6'-11"	6'-0"	7'-5"	---	6'-0"	5'-2"	6'-5"	---	5'-5"	4'-10"
		24	7'-5"	---	6'-0"	5'-2"	6'-0"	---	5'-2"	4'-7"	5'-2"	---	4'-10"	4'-2"
	250VS125-18	12	13'-6"	---	10'-8"	9'-5"	11'-10"	---	9'-5"	8'-2"	10'-8"	---	8'-6"	7'-5"
		16	12'-4"	---	9'-8"	8'-6"	10'-8"	---	8'-6"	7'-5"	9'-4"	---	7'-8"	6'-10"
		24	10'-8"	---	8'-6"	7'-5"	8'-10"	---	7'-5"	6'-6"	7'-7"	---	6'-10"	5'-11"
	362VS125-18	12	17'-1"	---	14'-1"	12'-4"	14'-0"	---	12'-4"	10'-8"	12'-1"	---	11'-2"	9'-10"
		16	14'-10"	---	12'-10"	11'-2"	12'-1"	---	11'-2"	9'-10"	10'-6"	---	10'-1"	8'-11"
		24	12'-1"	---	11'-2"	9'-10"	9'-11"	---	9'-10"	8'-6"	8'-7"	---	8'-7"	7'-8"
	400VS125-18	12	18'-1"	---	15'-1"	13'-2"	14'-10"	---	13'-2"	11'-7"	12'-10"	---	12'-0"	10'-6"
		16	15'-8"	---	13'-10"	12'-0"	12'-10"	---	12'-0"	10'-6"	11'-1"	---	10'-11"	9'-6"
		24	12'-10"	---	12'-0"	10'-6"	10'-6"	---	10'-6"	9'-2"	9'-1"	---	9'-1"	8'-4"
	600VS125-18	12	23'-10"	---	20'-5"	17'-10"	19'-6"	---	17'-0"	15'-7"	16'-10"	---	16'-2"	14'-1"
		16	20'-7"	---	18'-6"	16'-2"	16'-10"	---	16'-2"	14'-1"	14'-7"	---	14'-7"	12'-10"
		24	16'-10"	---	16'-2"	14'-1"	13'-10"	---	13'-10"	12'-5"	10'-6"	---	10'-6"	10'-6"

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.

(To be continued)

TABLE 6—LIMITING HEIGHTS FOR NON-COMPOSITE WALLS BRACED 4 FEET ON CENTERS (Continued)

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf				
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	
VIPER20D	162VS125-20	12	10'-7"	9'-6"	8'-8"	7'-7"	8'-7"	8'-4"	7'-7"	6'-7"	7'-6"	7'-6"	6'-11"	6'-0"	
		16	9'-2"	8'-8"	7'-11"	6'-11"	7'-6"	7'-6"	6'-11"	6'-0"	6'-6"	6'-6"	6'-4"	--	
		24	7'-6"	7'-6"	6'-11"	6'-0"	6'-1"	6'-1"	6'-0"	--	--	--	--	--	
	250VS125-20	12	14'-4"	13'-1"	11'-11"	10'-5"	11'-8"	11'-6"	10'-5"	9'-1"	10'-1"	10'-1"	9'-6"	8'-4"	
		16	12'-5"	11'-11"	10'-10"	9'-6"	10'-1"	10'-1"	9'-6"	8'-4"	8'-10"	8'-10"	8'-7"	7'-6"	
		24	10'-1"	10'-1"	9'-6"	8'-4"	8'-4"	8'-4"	8'-4"	7'-2"	7'-2"	7'-2"	7'-2"	6'-7"	
	362VS125-20	12	16'-2"	16'-2"	15'-10"	13'-10"	13'-2"	13'-2"	13'-2"	12'-0"	11'-5"	11'-5"	11'-5"	10'-11"	
		16	14'-0"	14'-0"	14'-0"	12'-6"	11'-5"	11'-5"	11'-5"	10'-11"	9'-11"	9'-11"	9'-11"	9'-11"	
		24	11'-5"	11'-5"	11'-5"	10'-11"	9'-4"	9'-4"	9'-4"	9'-4"	8'-1"	8'-1"	8'-1"	8'-1"	
	400VS125-21	12	17'-10"	17'-10"	17'-0"	14'-11"	14'-7"	14'-7"	14'-7"	13'-0"	12'-7"	12'-7"	12'-7"	11'-10"	
		16	15'-6"	15'-6"	15'-6"	13'-6"	12'-7"	12'-7"	12'-7"	11'-10"	10'-11"	10'-11"	10'-11"	10'-8"	
		24	12'-7"	12'-7"	12'-7"	11'-10"	10'-4"	10'-4"	10'-4"	10'-4"	8'-11"	8'-11"	8'-11"	8'-11"	
	600VS125-21	12	23'-1"	23'-1"	22'-6"	19'-8"	18'-11"	18'-11"	18'-11"	17'-2"	16'-5"	16'-5"	16'-5"	15'-7"	
		16	20'-0"	20'-0"	20'-0"	17'-11"	16'-5"	16'-5"	16'-5"	15'-7"	12'-10"	12'-10"	12'-10"	12'-10"	
		24	16'-5"	16'-5"	16'-5"	15'-7"	11'-5"	11'-5"	11'-5"	11'-5"	8'-7"	8'-7"	8'-7"	8'-7"	
	VIPER 27mil	162VS125-27	12	11'-5"	9'-11"	9'-0"	7'-11"	9'-7"	8'-8"	7'-11"	6'-11"	8'-4"	7'-11"	7'-2"	6'-4"
			16	10'-2"	9'-0"	8'-2"	7'-2"	8'-4"	7'-11"	7'-2"	6'-4"	7'-2"	7'-2"	6'-6"	--
			24	8'-4"	7'-11"	7'-2"	6'-4"	6'-10"	6'-10"	6'-4"	5'-6"	--	--	--	--
250VS125-27		12	15'-7"	13'-10"	12'-6"	10'-11"	12'-10"	12'-0"	10'-11"	9'-6"	11'-0"	10'-11"	9'-11"	8'-8"	
		16	13'-6"	12'-6"	11'-5"	9'-11"	11'-0"	10'-11"	9'-11"	8'-8"	9'-7"	9'-7"	9'-0"	7'-11"	
		24	11'-0"	10'-11"	9'-11"	8'-8"	9'-0"	9'-0"	8'-8"	7'-7"	7'-10"	7'-10"	7'-10"	6'-11"	
362VS125-27		12	18'-7"	18'-4"	16'-8"	14'-7"	15'-2"	15'-2"	14'-7"	12'-8"	13'-2"	13'-2"	13'-2"	11'-6"	
		16	16'-1"	16'-1"	15'-1"	13'-2"	13'-2"	13'-2"	13'-2"	11'-6"	11'-5"	11'-5"	11'-5"	10'-6"	
		24	13'-2"	13'-2"	13'-2"	11'-6"	10'-8"	10'-8"	10'-8"	10'-1"	9'-4"	9'-4"	9'-4"	9'-2"	
400VS125-27		12	19'-7"	19'-7"	18'-0"	15'-8"	16'-0"	16'-0"	15'-8"	13'-8"	13'-11"	13'-11"	13'-11"	12'-6"	
		16	17'-0"	17'-0"	16'-4"	14'-4"	13'-11"	13'-11"	13'-11"	12'-6"	12'-0"	12'-0"	12'-0"	11'-4"	
		24	13'-11"	13'-11"	13'-11"	12'-6"	11'-4"	11'-4"	11'-4"	10'-11"	9'-10"	9'-10"	9'-10"	9'-10"	
600VS125-27		12	25'-11"	25'-11"	24'-7"	21'-6"	21'-2"	21'-2"	21'-2"	18'-8"	18'-4"	18'-4"	18'-4"	17'-0"	
		16	22'-6"	22'-6"	22'-4"	19'-6"	18'-4"	18'-4"	18'-4"	17'-0"	14'-5"	14'-5"	14'-5"	14'-5"	
		24	18'-4"	18'-4"	18'-4"	17'-0"	12'-10"	12'-10"	12'-10"	12'-10"	9'-7"	9'-7"	9'-7"	9'-7"	

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa

(To be continued)

TABLE 6—LIMITING HEIGHTS FOR NON-COMPOSITE WALLS BRACED 4 FEET ON CENTERS (Continued)

Member (name)	Section ID XXXVS125-XX	Spacing (in. o.c.)	5 psf				7.5 psf				10 psf				
			L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	L/120	L/180	L/240	L/360	
VIPER 30mil	162VS125-30	12	11'-10"	10'-4"	9'-4"	8'-2"	10'-4"	9'-0"	8'-2"	7'-1"	8'-11"	8'-2"	7'-5"	6'-6"	
		16	10'-8"	9'-4"	8'-6"	7'-5"	8'-11"	8'-2"	7'-5"	6'-6"	7'-8"	7'-5"	6'-8"	--	
		24	8'-11"	8'-2"	7'-5"	6'-6"	7'-4"	7'-1"	6'-6"	--	6'-4"	6'-4"	--	--	
	250VS125-30	12	16'-4"	14'-2"	12'-11"	11'-4"	13'-7"	12'-5"	11'-4"	9'-11"	11'-10"	11'-4"	10'-4"	9'-0"	
		16	14'-5"	12'-11"	11'-8"	10'-4"	11'-10"	11'-4"	10'-4"	9'-0"	10'-2"	10'-2"	9'-4"	8'-1"	
		24	11'-10"	11'-4"	10'-4"	9'-0"	9'-7"	9'-7"	9'-0"	7'-10"	8'-4"	8'-4"	8'-1"	7'-1"	
	362VS125-30	12	20'-0"	19'-0"	17'-2"	15'-0"	16'-4"	16'-4"	15'-0"	13'-1"	14'-2"	14'-2"	13'-8"	11'-11"	
		16	17'-4"	17'-2"	15'-7"	13'-8"	14'-2"	14'-2"	13'-8"	11'-11"	12'-4"	12'-4"	12'-4"	10'-10"	
		24	14'-2"	14'-2"	13'-8"	11'-11"	11'-7"	11'-7"	11'-7"	10'-5"	10'-0"	10'-0"	10'-0"	9'-6"	
	400VS125-30	12	21'-1"	20'-6"	18'-7"	16'-4"	17'-2"	17'-2"	16'-4"	14'-2"	14'-11"	14'-11"	14'-10"	12'-11"	
		16	18'-4"	18'-4"	16'-11"	14'-10"	14'-11"	14'-11"	14'-10"	12'-11"	12'-11"	12'-11"	12'-11"	11'-8"	
		24	14'-11"	14'-11"	14'-10"	12'-11"	12'-2"	12'-2"	12'-2"	11'-4"	10'-7"	10'-7"	10'-7"	10'-2"	
	600VS125-30	12	28'-0"	28'-0"	25'-6"	22'-4"	22'-10"	22'-10"	22'-4"	19'-6"	19'-10"	19'-10"	19'-10"	17'-8"	
		16	24'-2"	24'-2"	23'-2"	20'-2"	19'-10"	19'-10"	19'-10"	17'-8"	17'-1"	17'-1"	17'-1"	16'-1"	
		24	19'-10"	19'-10"	19'-10"	17'-8"	15'-7"	15'-7"	15'-7"	15'-6"	11'-8"	11'-8"	11'-8"	11'-8"	
	VIPER 33mil	162VS125-33	12	12'-2"	10'-7"	9'-8"	8'-5"	10'-7"	9'-4"	8'-5"	7'-5"	9'-6"	8'-5"	7'-8"	6'-8"
			16	11'-1"	9'-8"	8'-10"	7'-8"	9'-6"	8'-5"	7'-8"	6'-8"	8'-2"	7'-8"	7'-0"	6'-1"
			24	9'-6"	8'-5"	7'-8"	6'-8"	7'-8"	7'-5"	6'-8"	--	6'-8"	6'-8"	6'-1"	--
250VS125-33		12	16'-11"	14'-8"	13'-5"	11'-8"	14'-5"	12'-11"	11'-8"	10'-2"	12'-6"	11'-8"	10'-7"	9'-4"	
		16	15'-4"	13'-5"	12'-2"	10'-7"	12'-6"	11'-8"	10'-7"	9'-4"	10'-10"	10'-7"	9'-7"	8'-5"	
		24	12'-6"	11'-8"	10'-7"	9'-4"	10'-2"	10'-2"	9'-4"	8'-1"	8'-10"	8'-10"	8'-5"	7'-5"	
362VS125-33		12	21'-4"	19'-7"	17'-10"	15'-7"	17'-5"	17'-1"	15'-7"	13'-7"	15'-1"	15'-1"	14'-1"	12'-5"	
		16	18'-5"	17'-10"	16'-2"	14'-1"	15'-1"	15'-1"	14'-1"	12'-5"	13'-0"	13'-0"	12'-11"	11'-2"	
		24	15'-1"	15'-1"	14'-1"	12'-5"	12'-4"	12'-4"	12'-4"	10'-10"	10'-8"	10'-8"	10'-8"	9'-10"	
400VS125-33		12	22'-6"	21'-2"	19'-4"	16'-10"	18'-4"	18'-4"	16'-10"	14'-8"	15'-11"	15'-11"	15'-4"	13'-4"	
		16	19'-5"	19'-4"	17'-6"	15'-4"	15'-11"	15'-11"	15'-4"	13'-4"	13'-10"	13'-10"	13'-10"	12'-1"	
		24	15'-11"	15'-11"	15'-4"	13'-4"	13'-0"	13'-0"	13'-0"	11'-8"	11'-2"	11'-2"	11'-2"	10'-7"	
600VS125-33		12	29'-10"	29'-2"	26'-6"	23'-1"	24'-4"	24'-4"	23'-1"	20'-2"	21'-1"	21'-1"	21'-0"	18'-5"	
		16	25'-10"	25'-10"	24'-1"	21'-0"	21'-1"	21'-1"	21'-0"	18'-5"	18'-4"	18'-4"	18'-4"	16'-8"	
		24	21'-1"	21'-1"	21'-0"	18'-5"	17'-2"	17'-2"	17'-2"	16'-0"	14'-6"	14'-6"	14'-6"	14'-6"	

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.

TABLE 7—ALLOWABLE CEILING SPANS

L/240		4 psf						6 psf					
Member (name)	Section ID XXXVS125-XX	Unsupported <sup>1</sup> Joist Spacing (in) o.c.			Supported at Midspan <sup>1</sup> Joist Spacing (in) o.c.			Unsupported <sup>1</sup> Joist Spacing (in) o.c.			Supported at Midspan <sup>1</sup> Joist Spacing (in) o.c.		
		12	16	24	12	16	24	12	16	24	12	16	24
VIPER25	162VS125-15	7'-3"	6'-9"	6'-0"	8'-1"	7'-4"	6'-5"	6'-6"	6'-0"	5'-5"	7'-1"	6'-5"	5'-7"
	250VS125-15	8'-2"	7'-7"	6'-10"	11'-3"	10'-4"	9'-0"	7'-4"	6'-10"	6'-2"	10'-0"	9'-0"	7'-8"
	362VS125-15	9'-1"	8'-6"	7'-8"	12'-0"	11'-0"	9'-9"	8'-3"	7'-8"	6'-11"	10'-8"	9'-9"	8'-5"
	400VS125-15	9'-5"	8'-9"	7'-10"	12'-5"	11'-4"	10'-0"	8'-6"	7'-10"	7'-1"	11'-0"	10'-0"	8'-9"
	600VS125-15	10'-8"	9'-11"	8'-11"	14'-4"	13'-2"	11'-8"	9'-7"	8'-11"	8'-1"	12'-9"	11'-8"	8'-10"
VIPER20	162VS125-19	7'-9"	7'-3"	6'-6"	8'-5"	7'-7"	6'-7"	7'-0"	6'-6"	5'-10"	7'-3"	6'-7"	5'-8"
	250VS125-19	8'-9"	8'-1"	7'-4"	12'-0"	10'-10"	9'-5"	7'-11"	7'-4"	6'-7"	10'-5"	9'-5"	8'-2"
	362VS125-19	9'-7"	8'-11"	8'-0"	13'-6"	12'-6"	11'-1"	8'-8"	8'-0"	7'-3"	12'-1"	11'-1"	9'-10"
	400VS125-19	9'-10"	9'-2"	8'-3"	13'-10"	12'-9"	11'-5"	9'-10"	9'-2"	8'-3"	12'-4"	11'-5"	10'-2"
	600VS125-19	11'-2"	10'-4"	9'-4"	15'-10"	14'-8"	13'-1"	10'-1"	9'-4"	8'-5"	14'-2"	13'-1"	11'-8"
VIPER20D	162VS125-20	7'-10"	7'-3"	6'-6"	9'-4"	8'-6"	7'-5"	7'-1"	6'-6"	5'-10"	8'-2"	7'-5"	6'-6"
	250VS125-20	8'-10"	8'-2"	7'-4"	12'-4"	11'-4"	10'-2"	7'-11"	7'-4"	6'-7"	11'-0"	10'-2"	8'-11"
	362VS125-20	9'-10"	9'-1"	8'-2"	13'-6"	12'-4"	10'-11"	8'-10"	8'-2"	7'-5"	11'-11"	10'-11"	9'-8"
	400VS125-21	10'-4"	9'-7"	8'-7"	14'-4"	13'-2"	11'-7"	9'-3"	8'-7"	7'-9"	12'-8"	11'-7"	10'-3"
	600VS125-21	11'-8"	10'-10"	9'-9"	16'-6"	15'-3"	13'-7"	10'-6"	9'-9"	8'-9"	14'-9"	13'-7"	12'-0"
VIPER 27mil	162VS125-27	8'-11"	8'-3"	7'-4"	9'-9"	8'-10"	7'-9"	8'-0"	7'-4"	6'-7"	8'-6"	7'-9"	6'-9"
	250VS125-27	10'-0"	9'-2"	8'-3"	13'-6"	12'-3"	10'-9"	8'-11"	8'-3"	7'-5"	11'-10"	10'-9"	9'-4"
	362VS125-27	11'-0"	10'-2"	9'-2"	15'-6"	14'-4"	12'-9"	9'-10"	9'-2"	8'-3"	13'-10"	12'-9"	11'-4"
	400VS125-27	11'-4"	10'-6"	9'-5"	15'-11"	14'-9"	13'-1"	10'-2"	9'-5"	8'-6"	14'-3"	13'-1"	11'-8"
	600VS125-27	12'-9"	11'-10"	10'-8"	18'-4"	16'-11"	15'-2"	11'-6"	10'-8"	9'-7"	16'-5"	15'-2"	13'-7"
VIPER 30mil	162VS125-30	9'-4"	8'-7"	7'-8"	10'-1"	9'-2"	8'-0"	8'-4"	7'-8"	6'-10"	8'-10"	8'-0"	7'-0"
	250VS125-30	10'-4"	9'-6"	8'-6"	13'-11"	12'-8"	11'-1"	9'-2"	8'-6"	7'-7"	12'-2"	11'-1"	9'-8"
	362VS125-30	11'-4"	10'-6"	9'-5"	16'-0"	14'-10"	13'-3"	10'-2"	9'-5"	8'-6"	14'-4"	13'-3"	11'-9"
	400VS125-30	11'-8"	10'-10"	9'-8"	16'-5"	15'-2"	13'-7"	10'-6"	9'-8"	8'-9"	14'-9"	13'-7"	12'-1"
	600VS125-30	13'-1"	12'-2"	10'-11"	18'-10"	17'-6"	15'-8"	11'-9"	10'-11"	9'-10"	16'-11"	15'-8"	14'-1"
VIPER 33mil	162VS125-33	9'-9"	8'-11"	7'-11"	10'-5"	9'-5"	8'-3"	8'-8"	7'-11"	7'-1"	9'-1"	8'-3"	7'-3"
	250VS125-33	10'-9"	9'-10"	8'-10"	14'-5"	13'-1"	11'-5"	9'-7"	8'-10"	7'-11"	12'-7"	11'-5"	10'-0"
	362VS125-33	11'-9"	10'-11"	9'-9"	16'-7"	15'-4"	13'-9"	10'-7"	9'-9"	8'-9"	14'-10"	13'-9"	12'-2"
	400VS125-33	12'-1"	11'-2"	10'-0"	17'-0"	15'-8"	14'-1"	10'-10"	10'-0"	9'-0"	15'-3"	14'-1"	12'-7"
	600VS125-33	13'-6"	12'-6"	11'-3"	19'-5"	18'-0"	16'-3"	12'-2"	11'-3"	10'-1"	17'-6"	16'-3"	14'-6"

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.

<sup>1</sup>All values are for simple spans, with compression flange either unbraced or braced at midspan. All framing members are laterally braced at ends.

TABLE 7—ALLOWABLE CEILING SPANS (Continued)


L/360		4 psf						6 psf					
Member (name)	Section ID XXXVS125-XX	Unsupported <sup>1</sup> Joist Spacing (in) o.c.			Supported at Midspan <sup>1</sup> Joist Spacing (in) o.c.			Unsupported <sup>1</sup> Joist Spacing (in) o.c.			Supported at Midspan <sup>1</sup> Joist Spacing (in) o.c.		
		12	16	24	12	16	24	12	16	24	12	16	24
VIPER25	162VS125-15	7'-1"	6'-5"	5'-7"	7'-1"	6'-5"	5'-7"	6'-2"	5'-7"	4'-11"	6'-2"	5'-7"	4'-11"
	250VS125-15	8'-2"	7'-7"	6'-10"	10'-0"	9'-0"	7'-11"	7'-4"	6'-10"	6'-2"	8'-8"	7'-11"	6'-11"
	362VS125-15	9'-1"	8'-6"	7'-8"	12'-0"	11'-0"	9'-9"	8'-3"	7'-8"	6'-11"	10'-7"	9'-9"	8'-5"
	400VS125-15	9'-5"	8'-9"	7'-10"	12'-5"	11'-4"	10'-0"	8'-6"	7'-10"	7'-1"	11'-0"	10'-0"	8'-9"
	600VS125-15	10'-8"	9'-11"	8'-11"	14'-4"	13'-2"	11'-8"	9'-7"	8'-11"	8'-1"	12'-9"	11'-8"	8'-10"
VIPER20	162VS125-19	7'-6"	6'-10"	5'-11"	7'-4"	6'-8"	5'-9"	6'-6"	5'-11"	5'-2"	6'-4"	5'-9"	5'-0"
	250VS125-19	8'-9"	8'-1"	7'-4"	10'-5"	9'-6"	8'-3"	7'-11"	7'-4"	6'-7"	9'-1"	8'-3"	7'-2"
	362VS125-19	9'-7"	8'-11"	8'-0"	13'-6"	12'-6"	11'-0"	8'-8"	8'-0"	7'-3"	12'-1"	11'-0"	9'-7"
	400VS125-19	9'-10"	9'-2"	8'-3"	13'-10"	12'-9"	11'-5"	8'-11"	8'-3"	7'-5"	12'-4"	11'-5"	10'-2"
	600VS125-19	11'-2"	10'-4"	9'-4"	15'-10"	14'-8"	13'-1"	10'-1"	9'-4"	8'-5"	14'-2"	13'-1"	11'-8"
VIPER20D	162VS125-20	7'-10"	7'-3"	6'-6"	8'-2"	7'-5"	6'-6"	7'-1"	6'-6"	5'-8"	7'-2"	6'-6"	5'-8"
	250VS125-20	8'-10"	8'-2"	7'-4"	11'-3"	10'-2"	8'-11"	7'-11"	7'-4"	6'-7"	9'-9"	8'-11"	7'-9"
	362VS125-20	9'-10"	9'-1"	8'-2"	13'-6"	12'-4"	10'-11"	8'-10"	8'-2"	7'-5"	11'-11"	10'-11"	9'-8"
	400VS125-21	10'-4"	9'-7"	8'-7"	14'-4"	13'-2"	11'-7"	9'-3"	8'-7"	7'-9"	12'-8"	11'-7"	10'-3"
	600VS125-21	11'-8"	10'-10"	9'-9"	16'-6"	15'-3"	13'-7"	10'-6"	9'-9"	8'-9"	14'-9"	13'-7"	12'-0"
VIPER 27mil	162VS125-27	8'-6"	7'-9"	6'-9"	8'-6"	7'-9"	6'-9"	7'-6"	6'-9"	5'-11"	7'-5"	6'-9"	5'-11"
	250VS125-27	10'-0"	9'-2"	8'-3"	11'-10"	10'-9"	9'-4"	8'-11"	8'-3"	7'-5"	10'-4"	9'-4"	8'-2"
	362VS125-27	11'-0"	10'-2"	9'-2"	15'-6"	14'-4"	12'-6"	9'-10"	9'-2"	8'-3"	13'-9"	12'-6"	10'-11"
	400VS125-27	11'-4"	10'-6"	9'-5"	15'-11"	14'-9"	13'-1"	10'-2"	9'-5"	8'-6"	14'-3"	13'-1"	11'-8"
	600VS125-27	12'-9"	11'-10"	10'-8"	18'-4"	16'-11"	15'-2"	11'-6"	10'-8"	9'-7"	16'-5"	15'-2"	13'-7"
VIPER 30mil	162VS125-30	8'-10"	8'-0"	7'-0"	8'-10"	8'-0"	7'-0"	7'-8"	7'-0"	6'-1"	7'-8"	7'-0"	6'-1"
	250VS125-30	10'-4"	9'-6"	8'-6"	12'-2"	11'-1"	9'-8"	9'-2"	8'-6"	7'-7"	10'-8"	9'-8"	8'-5"
	362VS125-30	11'-4"	10'-6"	9'-5"	16'-0"	14'-9"	12'-11"	10'-2"	9'-5"	8'-6"	14'-2"	12'-11"	11'-3"
	400VS125-30	11'-8"	10'-10"	9'-8"	16'-5"	15'-2"	13'-7"	10'-6"	9'-8"	8'-9"	14'-9"	13'-7"	12'-1"
	600VS125-30	13'-1"	12'-2"	10'-11"	18'-10"	17'-6"	15'-8"	11'-9"	10'-11"	9'-10"	16'-11"	15'-8"	14'-1"
VIPER 33mil	162VS125-33	9'-1"	8'-3"	7'-3"	9'-1"	8'-3"	7'-3"	7'-11"	7'-3"	6'-4"	7'-11"	7'-3"	6'-4"
	250VS125-33	10'-9"	9'-10"	8'-10"	12'-7"	11'-5"	10'-0"	9'-7"	8'-10"	7'-11"	11'-0"	10'-0"	8'-9"
	362VS125-33	11'-9"	10'-11"	9'-9"	16'-7"	15'-3"	13'-4"	10'-7"	9'-9"	8'-9"	14'-8"	13'-4"	11'-8"
	400VS125-33	12'-1"	11'-2"	10'-0"	17'-0"	15'-8"	14'-1"	10'-10"	10'-0"	9'-0"	15'-3"	14'-1"	12'-7"
	600VS125-33	13'-6"	12'-6"	11'-3"	19'-5"	18'-0"	16'-3"	12'-2"	11'-3"	10'-1"	17'-6"	16'-3"	14'-6"

For SI: 1 inch = 25.4 mm, 1 psf = 47.88 Pa.


<sup>1</sup>All values are for simple spans, with compression flange either unbraced or braced at midspan. All framing members are laterally braced at ends.






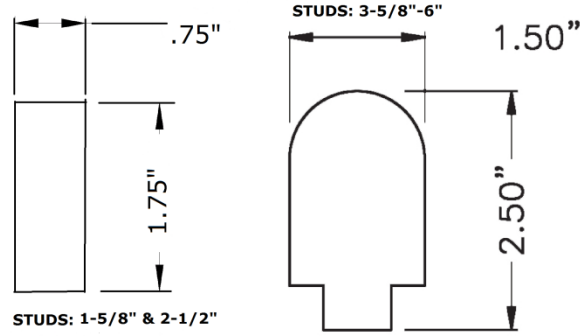

MarinoWARE

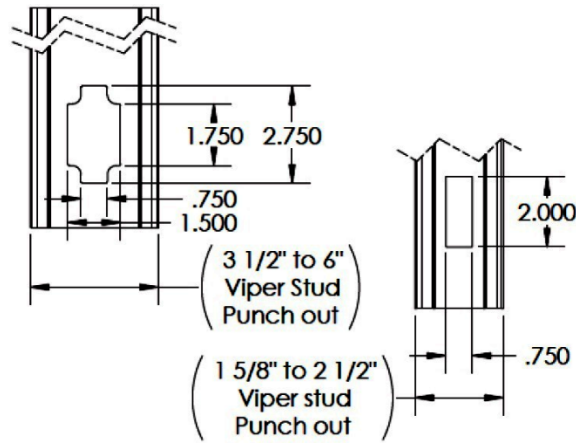

CEMCO, LLC

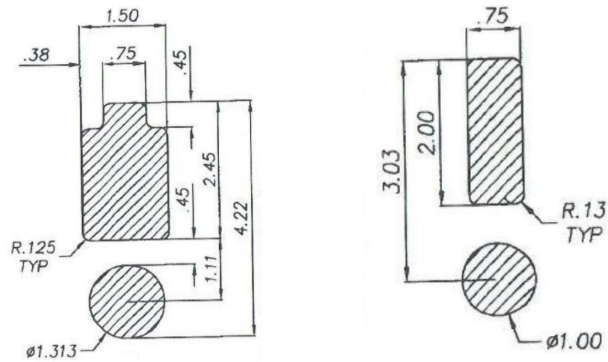

Studs: 3-1/2" to 6"

Studs: 1-5/8" to 2-1/2"

Imperial Building Products

FIGURE 2—PUNCH-OUT CONFIGURATIONS

**DIVISION: 05 00 00—METALS**

Section: 05 40 00—Cold-Formed Metal Framing

**DIVISION: 09 00 00—FINISHES**

Section: 09 22 16.13—Non-Structural Metal Stud Framing

**REPORT HOLDER:**

WARE INDUSTRIES, INC. (DBA MarinoWARE)

**EVALUATION SUBJECT:**

VIPERSTUD DRYWALL FRAMING SYSTEM (NON-STRUCTURAL): VIPER25, VIPER20, VIPER20D, VIPER 18MIL, VIPER 27MIL, VIPER 30MIL, AND VIPER 33MIL

## 1.0 REPORT PURPOSE AND SCOPE

**Purpose:**

The purpose of this evaluation report supplement is to indicate that the ViperStud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in ICC-ES evaluation report ESR-2620, have also been evaluated for compliance with the codes noted below as adopted by the New York City Department of Building.

**Applicable code editions:**

- 2022 *New York City Building Code*

## 2.0 CONCLUSIONS

The ViperStud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in Sections 2.0 through 7.0 of ICC-ES evaluation report ESR-2620, comply with the *New York City Building Code* Chapter 22, and are subject to conditions of use described in this supplement.

## 3.0 CONDITIONS OF USE

The ViperStud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in the evaluation report must comply with all the following conditions:

- All applicable sections in the evaluation report ESR-2620.
- The design, installation, conditions of use and identification of the ViperStud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil are in accordance with the 2015 *International Building Code*® (2015 IBC) provisions noted in the evaluation report ESR-2620.
- The design, installation, and inspection are in accordance with additional requirements of the 2022 *New York City Building Code* Chapters 16, 17 and 22, as applicable.

This supplement expires concurrently with the evaluation report, reissued July 2023 and revised November 2024.

**DIVISION: 05 00 00—METALS**

**Section: 05 40 00—Cold-Formed Metal Framing**

**DIVISION: 09 00 00—FINISHES**

**Section: 09 22 16.13—Non-Structural Metal Stud Framing**

**REPORT HOLDER:**

**WARE INDUSTRIES, INC. (DBA MarinoWARE)**

**EVALUATION SUBJECT:**

**VIPERSTUD DRYWALL FRAMING SYSTEM (NON-STRUCTURAL): VIPER25, VIPER20, VIPER20D, VIPER 18MIL, VIPER 27MIL, VIPER 30MIL, AND VIPER 33MIL**

## 1.0 REPORT PURPOSE AND SCOPE

**Purpose:**

The purpose of this evaluation report supplement is to indicate that Viperstud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in ICC-ES evaluation report ESR-2620, have also been evaluated for compliance with the codes noted below.

**Applicable code editions:**

- 2022 California Building Code (CBC)

For evaluation of applicable Chapters adopted by the [California Office of Statewide Health Planning and Development \(OSHPD\) AKA: California Department of Health Care Access and Information \(HCAI\) and the Division of State Architects \(DSA\)](#), see section 2.1.1 and 2.1.2 below.

- 2022 California Residential Code (CRC)

## 2.0 CONCLUSIONS

### 2.1 CBC:

The Viperstud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper 20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in Sections 2.0 through 7.0 of the evaluation report ESR-2620, comply with CBC Chapter 22, provided the design and installation are in accordance with the 2021 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements of the CBC Chapters 16, 17, and 22 as applicable.

**2.1.1 OSHPD:** The Viperstud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper 20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in Sections 2.0 through 7.0 of the evaluation report ESR-2620, comply with amended Sections in CBC Chapters 16, 17 and 22, and CBC Chapters 16A, 17A and 22A provided the design and installation are in accordance with the 2021 *International Building Code*® (IBC) provisions noted in the evaluation report and the additional requirements in Section 2.1.1.1 of this supplement:

#### 2.1.1.1 Conditions of Use:

1. In accordance with CBC Section 2211.2 and 2211A.2, for cold-formed steel light-frame construction, the design and installation of nonstructural members and connections shall be in accordance with AISI S220 for noncomposite assembly design. Where nonstructural members do not qualify for design under AISI 220, the design and installation of nonstructural members and connectors shall be in accordance with AISI S240 or S100 [OSHPD 1, 1R, 2, 4, and 5].
2. Storage racks and wall-hung cabinet loading per Table 1607.1 [OSHPD 1R, 2, and 5] and Table 1607A.1 [OSHPD 1 and 4] is excluded from this supplement.

**2.1.2 DSA:** The Viperstud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper 20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in Sections 2.0 through 7.0 of the evaluation report ESR-2620, comply with amended Sections in CBC Chapters 16 and 22, and CBC Chapters 16A, 17A and 22A, provided the design and installation are in accordance with the 2021 *International Building Code*<sup>®</sup> (IBC) provisions noted in the evaluation report and the additional requirements in Section 2.1.2.1 of this supplement:

**2.1.1.2 Conditions of Use:**

1. In accordance with CBC Section 2211A.2, for cold-formed steel light-frame construction, the design and installation of nonstructural members and connections shall be in accordance with AISI S220 for noncomposite assembly design. Where nonstructural members do not qualify for design under AISI 220, the design and installation of nonstructural members and connectors shall be in accordance with AISI S240 or S100 [DSA-SS].
2. Storage racks and wall-hung cabinet loading per Table 1607A.1 [DSA-SS] is excluded from this supplement.
3. Storage racks and wall-hung cabinet loading per Section 1617.5.1.5 [DSA-SS/CC] is excluded from this supplement.

**2.2 CRC:**

The Viperstud Drywall Framing Systems (Non-Structural): Viper25, Viper20, Viper20D, Viper 18mil, Viper 27mil, Viper 30mil, and Viper 33mil, described in Sections 2.0 through 7.0 of the evaluation report ESR-2620, comply with the 2022 CRC, provided the design and installation are in accordance with the 2021 *International Residential Code*<sup>®</sup> (IRC) provisions noted in the evaluation report.

This supplement expires concurrently with the evaluation report, reissued July 2023 and revised November 2024.

**DIVISION: 05 00 00—METALS**

Section: 05 40 00—Cold-Formed Metal Framing

**DIVISION: 09 00 00—FINISHES**

Section: 09 22 16.13—Non-Structural Metal Stud Framing

**REPORT HOLDER:**

WARE INDUSTRIES, INC. (DBA MarinoWARE)

**EVALUATION SUBJECT:**

VIPERSTUD DRYWALL FRAMING SYSTEM (NONSTRUCTURAL): VIPER25, VIPER20, VIPER20D, VIPER 18MIL, VIPER 27MIL, VIPER 30MIL, AND VIPER 33MIL

## 1.0 REPORT PURPOSE AND SCOPE

**Purpose:**

The purpose of this evaluation report supplement is to indicate that the ViperStud Drywall Framing System (Nonstructural), described in ICC-ES evaluation report ESR-2620, has also been evaluated for compliance with the codes noted below.

**Applicable code editions:**

- 2023 Florida Building Code—Building
- 2023 Florida Building Code—Residential

## 2.0 CONCLUSIONS

The ViperStud Drywall Framing System (Nonstructural), described in Sections 2.0 through 7.0 of ICC-ES evaluation report ESR-2620, complies with the *Florida Building Code—Building* and the *Florida Building Code—Residential*. The design requirements must be determined in accordance with the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable. The installation requirements noted in ICC-ES evaluation report ESR-2620 for the 2021 *International Building Code* meet the requirements of the *Florida Building Code—Building* or the *Florida Building Code—Residential*, as applicable.

Use of the ViperStud Drywall Framing System (Nonstructural) has also been found to be in compliance with the High-Velocity Hurricane Zone provisions of the *Florida Building Code—Building* and the *Florida Building Code—Residential*.

For products falling under Florida Rule 61G20-3, verification that the report holder's quality-assurance program is audited by a quality-assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official when the report holder does not possess an approval by the Commission).

This supplement expires concurrently with the evaluation report, reissued July 2023 and revised November 2024.