## Titen HD® Threaded Rod Hanger



The Titen HD threaded rod hanger is a high-strength screw anchor designed to suspend threaded rod from concrete slabs, beams or concrete over steel in order to hang pipes, cable trays and other HVAC equipment. The anchor offers low installation torque with no secondary setting, and has been tested to offer industry-leading performance in cracked and uncracked concrete — even in seismic loading conditions.

#### **Features**

- Thread design undercuts to efficiently transfer the load to the base material
- Serrated cutting teeth and patented thread design enable quick and easy installation
- Specialized heat-treating process creates tip hardness to facilitate cutting while the anchor body remains ductile
- Designed to install using a rotary hammer or hammer drill with standard ANSI drill bits — no special tools required
- Installs with standard-sized sockets
- Use in dry interior environments only
- Code listed for cracked and uncracked concrete applications under the 2015, 2012 and 2009 IBC/IRC, per ICC-ES ESR-2713
- FM listed

Codes: ICC-ES ESR-2713;


City of LA Supplement within ESR-2713; Florida FL15730 (concrete and masonry); Factory Mutual 3031136 (THD50234RH) and 3061897 (THDB37158RH)


Material: Carbon steel
Coating: Zinc plated


#### Installation


- Caution: Oversized holes in the base material will reduce or eliminate the mechanical interlock of the threads with base material and will reduce the anchor's load capacity.
- Caution: Use a Titen HD rod hanger one time only. Installing the anchor multiple times may result in excessive thread wear and reduce load capacity.
- Drill a hole using the specified diameter carbide bit into the base material to the specified embedment depth plus minimum hole depth overdrill (see the product data table on the next page).
- 2. Blow the hole clean of dust and debris using compressed air.
- Install with a torque wrench, driver drill, hammer drill or cordless impact wrench.
- 4. Fully insert threaded rod.

### Installation Sequence










THD50234RH

(%"-dia. shank)









THDB37158RH (1/4"-dia. shank)

THDB25158RH (1/4"-dia. shank)

Overdrill depth (see product data table on the next page)

# **Titen HD®** Rod Hanger Design Information — Concrete



### Titen HD Threaded Rod Hanger Product Data

Size (in.)	Model	Accepts Rod Size	Drill Bit Dia.	Wrench Size	Min. Embed.	Hole Depth Overdrill	Quantity		
	(in.)	No.	(in.)	(in.)	(in.)	(in.)	(in.)	Вох	Carton
Cracked	1⁄4 x 15⁄8	THDB25158RH	1/4-20	1/4	3/8	15⁄8	1/8	100	500
FM Cracked Concrete	3⁄8 x 15⁄8	THDB37158RH	3⁄8-16	1/4	1/2	15⁄8	1/8	50	200
FM Cracked Concrete	½ x 2¾	THD50234RH	1/2-13	3/8	11/16	2½	1/4	50	100

### Titen HD Threaded Rod Hanger Installation Information and Additional Data<sup>1</sup>

			Model No.			
Characteristic	Symbol	Units	THDB25158RH THDB37158RH	THD50234RH		
Installation Information						
Rod Hanger Diameter	d <sub>o</sub>	in.	1/4 or 3/8	1/2		
Drill Bit Diameter	d <sub>bit</sub>	in.	1/4	3/8		
Maximum Installation Torque <sup>2</sup>	T <sub>inst,max</sub>	ftlb.	24	50		
Maximum Impact Wrench Torque Rating <sup>3</sup>	T <sub>impact,max</sub>	ftlb.	125	150		
Minimum Hole Depth	h <sub>hole</sub>	in.	13/4	3		
Embedment Depth	h <sub>nom</sub>	in.	1%	2¾		
Effective Embedment Depth	h <sub>ef</sub>	in.	1.19	1.77		
Critical Edge Distance	C <sub>ac</sub>	in.	3	211/16		
Minimum Edge Distance	C <sub>min</sub>	in.	1½	13/4		
Minimum Spacing	S <sub>min</sub>	in.	1½	3		
Minimum Concrete Thickness	h <sub>min</sub>	in.	31/4	41/4		
	Anch	or Data				
Yield Strength	f <sub>ya</sub>	psi	100,000	97,000		
Tensile Strength	f <sub>uta</sub>	psi	125,000	110,000		
Minimum Tensile and Shear Stress Area	A <sub>se</sub>	in. <sup>2</sup>	0.042	0.099		
Axial Stiffness in Service Load Range — Uncracked Concrete	$eta_{\mathit{uncr}}$	lb./in.	202,000	672,000		
Axial Stiffness in Service Load Range — Cracked Concrete	$eta_{cr}$	lb./in.	173,000	345,000		

<sup>1.</sup> The information presented in this table is to be used in conjunction with the design criteria of ACI 318-19 Chapter 17, ACI 318-14 Chapter 17 or ACI 318-11 Appendix D.

<sup>2.</sup> T<sub>inst,max</sub> is the maximum permitted installation torque for installations using a torque wrench.

 $<sup>3.</sup>T_{impact,max}$  is the maximum permitted torque rating for impact wrenches.

# **Titen HD®** Rod Hanger Design Information — Concrete



Titen HD Threaded Rod Hanger Tension Strength Design Data for Installations in Concrete<sup>1</sup>

	1 1
PC	ı
DU	ı
_	







			Model No.		
Characteristic	Symbol	Units	THDB25158RH THDB37158RH	THD50234RH	
Anchor Category	1, 2 or 3	_		1	
Embedment Depth	h <sub>nom</sub>	in.	1%	2½	
Steel Strength in Tension (ACI 318-19 17.6.1, ACI 318-14 17.4.1 or ACI 318-11 Section D.5.1)					
Tension Resistance of Steel	N <sub>sa</sub>	lb.	5,195	10,890	
Strength Reduction Factor — Steel Failure <sup>2</sup>	$\phi_{sa}$	_	0.65		
Concrete Breakout Strength in Tension (ACI 318-19 17.6.2, ACI 318-14 17.4.2 or ACI 318-11 Section D.5.2)					
Effective Embedment Depth	h <sub>ef</sub>	in.	1.19	1.77	
Critical Edge Distance	$c_{ac}$	in.	3	211/16	
Effectiveness Factor — Uncracked Concrete	K <sub>uncr</sub>	_	30	24	
Effectiveness Factor — Cracked Concrete	Kcr	J –	17		
Modification Factor	$\psi_{c,N}$	_	1.0		
Strength Reduction Factor — Concrete Breakout Failure <sup>2</sup>	$\phi_{cb}$	_	0.65		
Pullout Strength in Tension (ACI 318-19 17.6.3, ACI 318-14 17.4.3 or ACI 318-11 Section D.5.3)					
Pullout Resistance — Uncracked Concrete (f' c = 2,500 psi)	N <sub>p,uncr</sub>	lb.	N/A <sup>4</sup>	2,0254	
Pullout Resistance — Cracked Concrete (f' <sub>c</sub> = 2,500 psi)	N <sub>p,cr</sub>	lb.	N/A <sup>4</sup>	1,2354	
Strength Reduction Factor — Pullout Failure <sup>2</sup>	$\phi_{ ho}$	_	0.65		
Tension Strength for Seismic Applications (ACI 318-19 17.10.3, ACI 318-14 17.2.3.3 or ACI 318-11 Section D.3.3.3)					
Nominal Pullout Strength for Seismic Loads (f $^{\circ}_{c}$ = 2,500 psi)	$N_{p,eq}$	lb.	N/A³	1,235⁴	
Strength Reduction Factor — Pullout Failure <sup>2</sup>	$\phi_{eq}$	_	0.	65	

<sup>1.</sup> The information presented in this table is to be used in conjunction with the design criteria of ACI 318-19 Chapter 17, ACI 318-14 Chapter 17 or ACI 318-11 Appendix D, as applicable.

<sup>2.</sup> The strength reduction factor applies when the load combinations from the IBC or ACI 318 are used and the requirements of ACI 318-19 17.5.3, ACI 318-14 17.3.3 or ACI 318-11 D.4.3, as applicable, are met. If the load combinations of ACI 318-11 Appendix C are used, the appropriate strength reduction factor must be determined in accordance with ACI 318-11 D.4.4.

<sup>3.</sup> As described in this report, N/A denotes that pullout resistance does not govern and does not need to be considered.

<sup>4.</sup> The characteristic pullout resistance for greater compressive strengths may be increased by multiplying the tabular value by (t'<sub>1</sub>/2,500)<sup>0.5</sup>.

Units

in.

in.

in.

lbf

lbf

**Mechanical** Anchors

## **Titen HD®** Rod Hanger Design Information — Concrete

Titen HD Threaded Rod Hanger Tension Strength Design Data for Installations in the Lower and Upper Flute of Normal-Weight or Sand-Lightweight Concrete Through Steel Deck<sup>1,2,5,6</sup>

**Symbol** 

h<sub>hole</sub>

 $h_{nom}$ 

h<sub>ef</sub>

N<sub>p,deck,cr</sub>

 $N_{p,deck,uncr}$ 

IRC		1
IDU	ш	200

Model No.

Figure 1

THD50234RH

3

21/2

1.77

870

1.430

**Lower Flute** 

Figure 2

THDB25158RH

THDB37158RH

13/4

15/8

1.19

420

995



,	
	Upper Flute
	Figure 2
	THDB25158RH THDB37158RH
	1 3/4

1 1 1/8

1.19

655

1.555

- 1. The information presented in this table is to be used in conjunction with the design criteria of ACI 318-19 Chapter 17, ACI 318-14 Chapter 17 or ACI 318-11 Appendix D, as applicable.
- Concrete compressive strength shall be 3,000 psi minimum. The characteristic pullout resistance for greater compressive strengths shall be increased by multiplying the tabular value by (f'<sub>cr.specified</sub>/3,000 psi)<sup>0.5</sup>.
- 3. For anchors installed in the soffit of sand-lightweight or normal-weight concrete over steel deck floor and roof assemblies, as shown in Figure 1 or Figure 2, calculation of the concrete breakout strength may be omitted.
- 4. In accordance with ACI 318-19 Section 17.6.3.2.1, ACI 318-14 Section 17.4.3.2 or ACI 318-11 Section D.5.3.2, the nominal pullout strength in cracked concrete for anchors installed in the soffit of sand-lightweight or normal-weight-concrete-over-steel-deck floor and roof assemblies N<sub>p,deck,cr</sub> shall be substituted for N<sub>p,cr</sub>. Where analysis indicates no cracking at service loads, the normal pullout strength in uncracked concrete N<sub>p,deck,uncr</sub> shall be substituted for N<sub>p,uncr</sub>.
- 5. Minimum distance to edge of panel is 2hef.

Characteristic

Pullout Resistance - Cracked Concrete<sup>2,3,4</sup>

Pullout Resistance – Uncracked Concrete<sup>2,3,4</sup>

Minimum Hole Depth

Effective Embedment Depth

**Embedment Depth** 

6. The minimum anchor spacing along the flute must be the greater of 3h<sub>ef</sub> or 1.5 times the flute width.

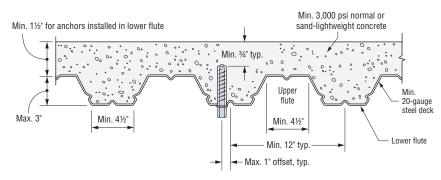


Figure 1. THD50234RH Installation in Concrete over Steel Deck

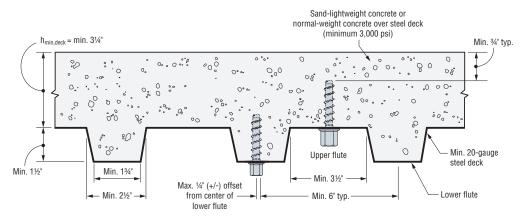


Figure 2. THDB25158RH and THDB37158RH Installation in Concrete over Steel Deck